

Removal and relationships of microbial indicators in a water treatment and reclamation facility

Laura Alcalde, Montserrat Folch and Josefina C. Tapias

ABSTRACT

A wastewater treatment and reclamation facility in north-east Spain was monitored over 1 year to determine the occurrence and concentrations of different microbial indicators (*Escherichia coli*, fecal enterococci, somatic bacteriophages and spores of sulfite-reducing clostridia). The removal of the indicators and its relationships through the wastewater treatment and reclamation trains were evaluated. The results obtained show that the reclamation treatments evaluated present a different efficiency in indicator microorganisms' removal depending on the type of microorganism. The *E. coli* and enterococci present an average reduction slightly higher than the other indicators, followed by somatic bacteriophages and spores of sulfite-reducing clostridia. The Spearman's correlations indicate that it is not suitable to use any of the bacterial indicators evaluated to predict the content of virus or spores of sulfite-reducing clostridia. Therefore, in order to evaluate the microbiological risk of the reclaimed effluent use, it is necessary to monitor the three types of indicator microorganisms (bacteria, virus and protozoa).

Key words | microbial indicators, reclamation, reuse, treatment technology, wastewater

Laura Alcalde (corresponding author)
Montserrat Folch
Josefina C. Tapias
Soil Science Laboratory,
University of Barcelona,
Avda. Joan XXIII s/n,
08028 Barcelona,
Spain
E-mail: lalcalde@ub.edu

INTRODUCTION

The contribution of reclaimed water to sustainable water resources is expected to increase in many areas of the world, including some parts of the USA (Asano 2002) and European areas from the northern shore of the Mediterranean Sea (Angelakis *et al.* 2003). Reclaimed water is a valuable but under-utilized resource due partly to the uncertainties about the potential health risks associated with reclaimed water exposure. When reusing, one of the greatest threats to human health is considered to be posed by pathogenic microorganisms (Toze 2006). Since a wide variety of pathogenic microorganisms can be found in wastewater, including bacteria, viruses, protozoan and parasitic worms, in order to minimize public health risks the most important goal is the reduction of pathogens during reclamation treatments. Nevertheless, due to the difficulty to determine directly all the pathogens, indicators for several of them are routinely used.

Consequently, at present, reclaimed water quality is mainly assessed through routine monitoring for the

presence of bacterial indicators and nematode eggs which are included in different regulations and guidelines around the world (USEPA 2004; WHO 2006). In Spain, in December 2007, a national regulation on reclaimed water quality criteria was issued (RD 1620/2007) determining five different categories of uses: urban, agricultural, industrial, recreational and environmental. These quality criteria rely mainly on several microbiological and physicochemical parameters (*Escherichia coli*, nematode eggs, suspended solids and turbidity) although for some uses more than 70 parameters must be controlled. The maximum levels permitted for each parameter are dependent on the specific use. For the main parameters, *E. coli* maximum levels are between 0 and 10,000 colony-forming units (CFU)/100 mL, nematode eggs are between 1 egg/10 L to no limitation, suspended solids range between 5 and 35 mg/L and turbidity levels are between 1 and 15 NTU.

It should be noted that a universally accepted standard to regulate the quality of reclaimed water does not exist.

E. coli is one of the most used indicators in regulations and standards worldwide (Lucena *et al.* 2004; Harwood *et al.* 2005).

Bacteriophages infecting enteric bacteria and spores of sulfite-reducing clostridia have been suggested as indicators for viruses (IAWPRC 1991) and protozoa (Payment *et al.* 1985). In this sense, somatic bacteriophages are one of the groups proposed among bacteriophages (Kott *et al.* 1974).

In the Mediterranean area, as elsewhere, studies evaluating treatment technologies for reclaimed effluent production on an industrial scale monitoring different types of microbiological indicators at the same time are limited. The aim of this study is to determine and enumerate the levels of indicators in raw water, secondary and tertiary effluents in order to assess the effects of treatment trains on the removal of these microorganisms and to determine the behavior and relationships of the indicators studied.

METHODS

Water treatment and reclamation plants studied

This study was performed in a treatment facility consisting of a wastewater treatment plant (WWTP) followed by a water reclamation plant (WRP). The facility is located in Catalonia, in the north-east of Spain, which has a typical Mediterranean climate. The WWTP has a design flow of 47,500 m³/day. The facility has a population equivalent of 210,583, a design suspended solids content of 232 mg/L and a BOD₅ of 266 mg/L. The design flow of the WRP is 16,500 m³/day. The flow diagrams of the WWTP and the WRP trains can be found in Figures 1 and 2.

The chlorination is carried out in the WRP using sodium hypochlorite. The dosage is 8 mg/L with a contact time of 12 minutes in order to achieve residual chlorine of 1 mg/L in the reclaimed effluent.

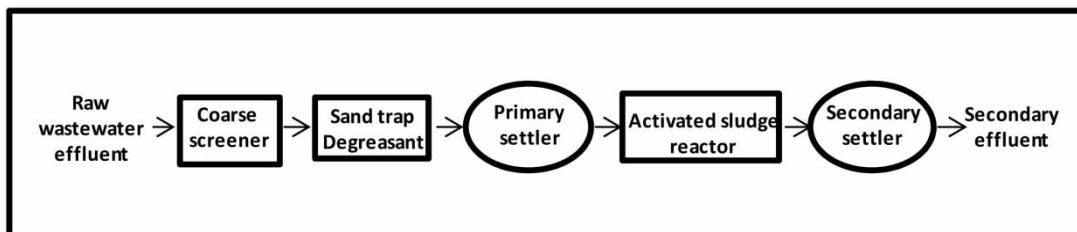


Figure 1 | Flow diagram of the WWTP.

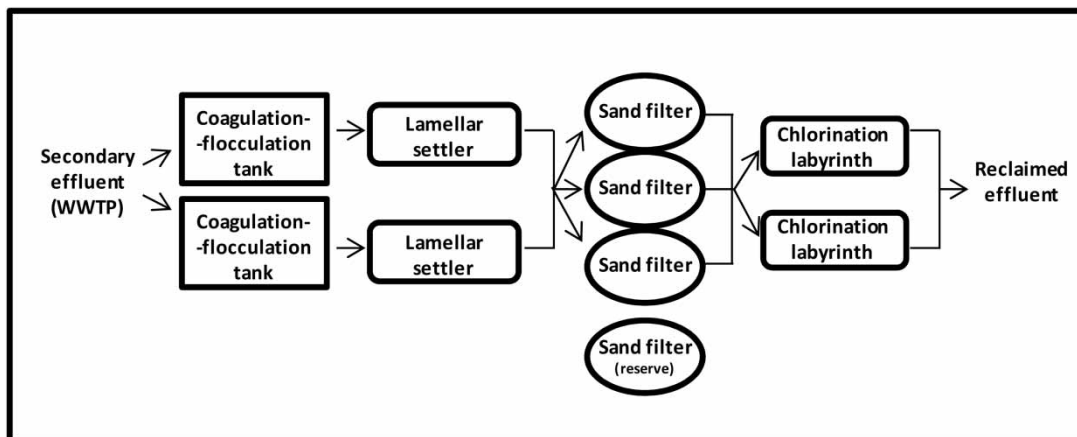


Figure 2 | Flow diagram of the WRP.

Samples and sampling

In order to evaluate the microbiological quality of the wastewater throughout the WWTP and WRP facilities, the following sampling points were selected:

- Inlet to the primary settler (considered here the raw wastewater effluent);
- Outlet of the secondary settler (considered here the secondary effluent);
- Outlet of the chlorination labyrinth (considered here the reclaimed effluent).

Sampling was done at all sampling points weekly, on Tuesday morning, for 1 year. The number of samples analyzed for each sampling point was from 38 to 40. All samples were analyzed for the presence of microbial indicators and pathogenic microorganisms. The microbial indicators selected were *E. coli*, fecal enterococci, somatic bacteriophages and spores of sulfite-reducing clostridia. Analytical methods for microorganisms' quantification are shown in Table 1.

Water samples were collected, preserved and transported according to the procedures described in APHA (2005) on water sampling for microbiological analysis.

The SPSS software version 19.0 was used for statistical calculations. The statistics analyzed are the descriptive

statistics and Spearman's correlations. The significance level (p) used has been a bilateral p of 0.05 ($p \leq 0.05$).

The water samples of the reclaimed effluent were analyzed for the somatic bacteriophage content using a concentration method, filtering the volume of water through a nitrocellulose filter of 0.22 μm , as described in Sobsey *et al.* (1982), and according to the modifications made by Méndez *et al.* (2004).

RESULTS AND DISCUSSION

Microorganism indicator densities in different water effluents

Descriptive statistical parameters of indicator microorganisms are shown in Table 2. In order to show the dispersion of the results obtained, confidence levels at 95% of the average content at the different sampling points and average removals of indicator microorganisms in secondary and tertiary treatments are shown in Figures 3 and 4, respectively.

The indicator *E. coli* in raw wastewater shows the highest concentration of all the microorganism concentrations evaluated, followed by the somatic bacteriophages, fecal enterococci and spores of sulfite-reducing clostridia (Table 1). These figures and proportions between the indicators are in agreement with those found in raw wastewaters of other Spanish WWTPs treating urban wastewater (Lucena 2008).

In the secondary effluent, the content of all the microorganisms evaluated has diminished, but the proportions are the same as in raw wastewater, *E. coli* being the most abundant, followed by somatic bacteriophages, fecal enterococci and spores of sulfite-reducing clostridia.

Tertiary effluent presents some differences regarding the proportions (relative contents) of the indicator microorganisms evaluated in comparison with the other types of samples. Somatic bacteriophages show the highest concentration of all microorganisms, followed by spores of sulfite-reducing clostridia, *E. coli* and fecal enterococci (Figure 3).

The mean content and proportions of the indicator microorganisms evaluated in the secondary and reclaimed effluents are similar to the ones described in several studies in Spain and in other areas of the world where urban waters

Table 1 | Microbiological parameters and analytical methods utilized during this study

Parameter	Analytical method
<i>Escherichia coli</i> (<i>E. coli</i>)	APHA (2005) ref. 9222-D Membrane filtration Culture media: chromID™ Coli (COLI ID-F) Biomérieux
Fecal enterococci	APHA (2005) ref. 9230-C Membrane filtration Culture media: Difco™ m Enterococcus Agar
Spores of sulfite-reducing clostridia	APHA (2005) ref. 9222-D Membrane filtration Culture media: BBL™ TSN Agar
Somatic bacteriophages	ISO 10705-2 (2000) Host strain: WG5- <i>E. coli</i> CN (ATCC 700078)

Table 2 | Descriptive statistics of the concentration of indicator microorganisms at the different sampling points' effluents

	Indicator microorganisms concentration (log ₁₀ units/100 mL)			
	Minimum	Maximum	Average	Standard deviation
Raw wastewater effluent				
<i>E. coli</i> (<i>n</i> = 40)	6.30	7.61	7.02	0.29
Fecal enterococci (<i>n</i> = 40)	5.41	6.09	5.87	0.17
Somatic bacteriophages (<i>n</i> = 40)	5.74	7.46	6.69	0.32
Spores of sulfite-reducing clostridia (<i>n</i> = 39)	2.00	5.09	4.06	0.62
Secondary effluent				
<i>E. coli</i> (<i>n</i> = 40)	3.70	6.17	5.22	0.58
Fecal enterococci (<i>n</i> = 40)	3.15	5.10	4.12	0.56
Somatic bacteriophages (<i>n</i> = 40)	4.01	5.97	4.92	0.45
Spores of sulfite-reducing clostridia (<i>n</i> = 40)	1.18	3.42	2.46	0.47
Reclaimed effluent				
<i>E. coli</i> (<i>n</i> = 40)	0.00	6.01	1.81	1.99
Fecal enterococci (<i>n</i> = 40)	0.00	4.70	1.55	1.59
Somatic bacteriophages (<i>n</i> = 39)	0.30	5.78	4.07	1.06
Spores of sulfite-reducing clostridia (<i>n</i> = 38)	0.70	3.41	1.83	0.70

n: number of samples analyzed.

are treated and reclaimed (Duran *et al.* 2003; Lucena *et al.* 2004; Harwood *et al.* 2005; Mandilara *et al.* 2006; Costán-Longares *et al.* 2008).

The average reduction of the indicator microorganisms studied through the different treatments of the WWTP does not present significant differences ($p > 0.05$), having similar values for *E. coli* (1.80 log₁₀ units/100 mL), fecal enterococci (1.77 log₁₀ units/100 mL), somatic bacteriophages (1.75 log₁₀ units/100 mL), and sulfite-reducing clostridia (1.60 log₁₀ units/100 mL) (Figure 4).

WWTP treatments (pretreatment, primary settling, activated sludge process and secondary settling) have a certain disinfection capacity due to the natural die-off of the microorganisms and adsorption onto the biological flocs, and the attachment of some microorganisms to suspended particles that are removed by the sedimentation processes (Tchobanoglous *et al.* 2003).

According to several authors (Lucena *et al.* 2004; Mandilara *et al.* 2006), the most important percentage of inactivation is produced during the activated sludge biological treatment and secondary settling.

This type of wastewater treatment seems to reduce the microorganisms' concentration of the indicators in a similar

manner. However, the *E. coli* and enterococci present an average reduction slightly higher than the other indicators, followed by somatic bacteriophages and spores of sulfite-reducing clostridia. These results are in agreement with those of other authors (Rose *et al.* 1996; Gantzer *et al.* 1998; Durán *et al.* 2003; Mandilara *et al.* 2006; Wen *et al.* 2009).

The average reduction of the indicator microorganisms during the reclamation treatment presents differences between the indicators evaluated. *E. coli* shows the highest removal rate (3.41 log₁₀ units/100 mL), followed by fecal enterococci (2.49 log₁₀ units/100 mL) somatic bacteriophages (0.90 log₁₀ units/100 mL) and sulfite-reducing clostridia (0.67 log₁₀ units/100 mL) (Figure 4).

There are significant differences between the removal of *E. coli* and fecal enterococci, and also between the average removal of somatic bacteriophages and sulfite-reducing clostridia (Figure 3). *E. coli* and fecal enterococci are more efficiently removed than somatic bacteriophages and sulfite-reducing clostridia.

These results can be explained by the fact that somatic bacteriophages and spores of sulfite-reducing clostridia have higher resistance to chlorine disinfection than *E. coli* and fecal enterococci (Ashbolt *et al.* 2000; Araujo *et al.* 2004).

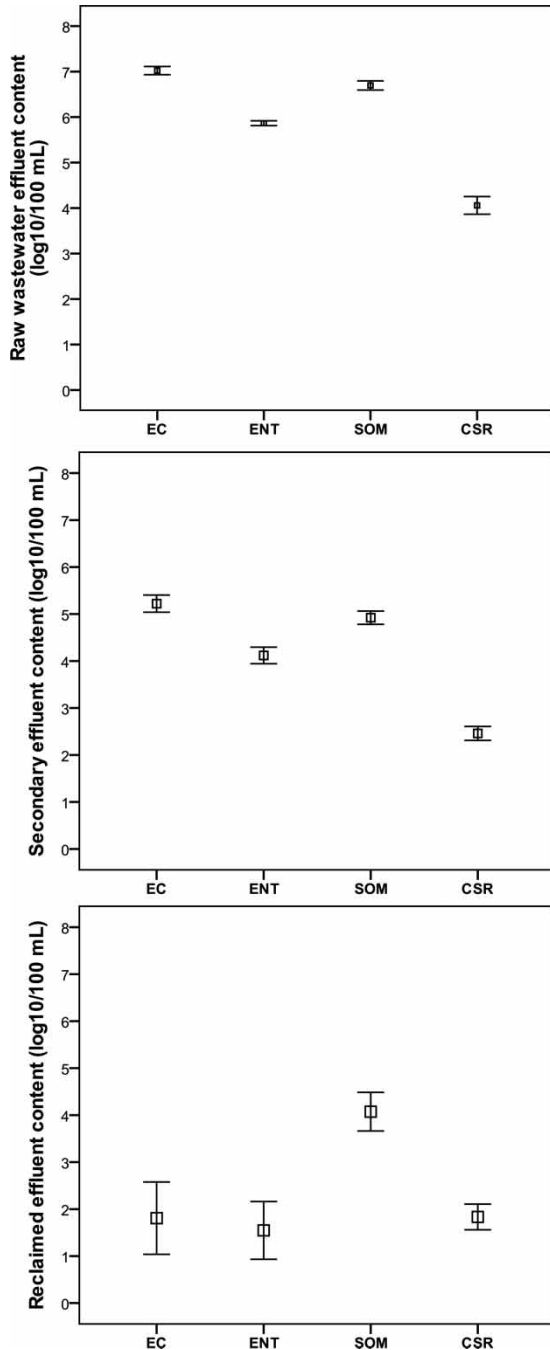


Figure 3 | Confidence levels at 95% of the average content of *E. coli* (EC), fecal enterococci (ENT), somatic bacteriophages (SOM) and spores of sulfite-reducing clostridia (CSR) in raw wastewater, secondary and reclaimed effluent.

The average removal values found in this study for the microorganisms evaluated are similar to the removal values described in other studies performed in reclamation facilities consisting of a physicochemical process and a

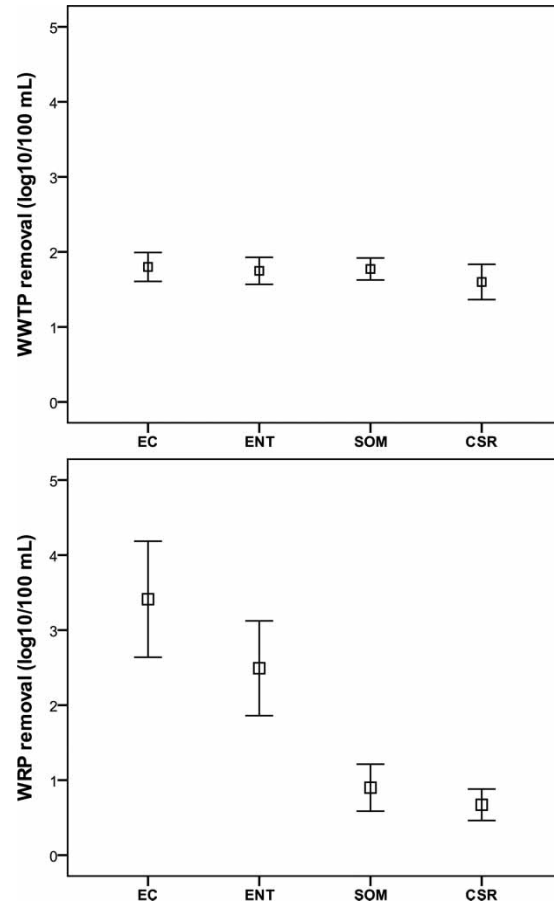


Figure 4 | Confidence levels at 95% of the average removal of *E. coli* (EC), fecal enterococci (ENT), somatic bacteriophages (SOM) and spores of sulfite-reducing clostridia (CSR) achieved by the WWTP and the WRP.

chlorine disinfection treatment (Havelaar 1987; Tartera *et al.* 1988; Mandilara *et al.* 2006).

The results obtained show that the reclamation treatments evaluated present a different efficiency in indicator removal depending on the type of microorganism. This fact has not been observed during the treatment in the WWTP, where all microorganisms determined were removed in a similar manner. This behavior is consistent with the results described in other studies (Scott *et al.* 2003; Mandilara *et al.* 2006; Costán-Longares *et al.* 2008).

The Spanish RD 1620/2007 indicates the maximum level of *E. coli* concentration allowed for irrigation of green areas (2.3 log₁₀ units/100 mL). The reclaimed water obtained in the facility evaluated meets this requirement in all the samples except one which presented a concentration of 6.00 log₁₀ units/100 mL. This fact was due to a failure in

the chlorine dosage that was rapidly fixed by the plant technicians.

The differences in the proportions among the indicators evaluated can also be explained, to some extent, by the operational regime of the reclamation facility. The reclamation facility does not operate in a continuous mode, and the operation depends on the irrigation demands of the park. Therefore, the facility may not be operating for 1 to 3 days, depending on the irrigation demands. This fact can affect the efficiency and reliability of the facility.

Relationships among the indicator microorganisms evaluated

In order to determine the relationships between densities of the indicators evaluated, bilateral Spearman's correlations (p bilateral ≤ 0.05) were performed (Table 3).

In the secondary effluent, a significant correlation was found between *E. coli* and fecal enterococci ($r = 0.81$,

$p = 0.00$), it being the highest correlation. Other significant correlations, but with lower correlation coefficients and weaker relationships, corresponded to the relationships between fecal enterococci and spores of sulfite-reducing clostridia ($r = 0.48$, $p = 0.00$), and between *E. coli* and sulfite-reducing clostridia ($r = 0.36$, $p = 0.02$). There were no significant correlations between somatic bacteriophages and the rest of the indicator microorganisms evaluated (Table 3).

In the reclaimed effluent, bilateral Spearman's correlation between *E. coli* and fecal enterococci ($r = 0.90$, $p = 0.00$) was found to be significant and very high. There were also significant correlations, but with a lower coefficient, between *E. coli* and somatic bacteriophages ($r = 0.65$, $p = 0.00$), *E. coli* and sulfite-reducing clostridia ($r = 0.58$, $p = 0.00$), fecal enterococci and somatic bacteriophages ($r = 0.64$, $p = 0.00$), fecal enterococci and sulfite-reducing clostridia ($r = 0.55$, $p = 0.00$) and between somatic bacteriophages and sulfite-reducing clostridia ($r = 0.45$, $p = 0.01$).

Table 3 | Spearman's correlation results on the comparison between the microorganisms indicators evaluated in the secondary and reclaimed effluents

	Spearman's correlations (p bilateral ≤ 0.05)			
	<i>E. coli</i>	Fecal enterococci	Somatic bacteriophages	Spores of sulfite-reducing clostridia
Secondary effluent				
<i>E. coli</i>	1	$r = 0.81$ $p = 0.00$	$r = -0.53$ $p = 0.74$	$r = 0.36$ $p = 0.02$
Fecal enterococci	$r = 0.81$ $p = 0.00$	1	$r = -0.02$ $p = 0.90$	$r = 0.48$ $p = 0.00$
Somatic bacteriophages	$r = -0.53$ $p = 0.74$	$r = -0.02$ $p = 0.90$	1	$r = 0.30$ $p = 0.06$
Spores of sulfite-reducing clostridia	$r = 0.36$ $p = 0.02$	$r = 0.48$ $p = 0.00$	$r = 0.30$ $p = 0.06$	1
Reclaimed effluent				
<i>E. coli</i>	1	$r = 0.90$ $p = 0.00$	$r = 0.65$ $p = 0.00$	$r = 0.58$ $p = 0.00$
Fecal enterococci	$r = 0.90$ $p = 0.00$	1	$r = 0.64$ $p = 0.00$	$r = 0.55$ $p = 0.00$
Somatic bacteriophages	$r = 0.8$ $p = 0.00$	$r = 0.64$ $p = 0.00$	1	$r = 0.45$ $p = 0.01$
Spores of sulfite-reducing clostridia	$r = 0.8$ $p = 0.00$	$r = 0.55$ $p = 0.00$	$r = 0.45$ $p = 0.01$	1

r : correlation coefficient; p : significance level.

The results described are in agreement with the results obtained in other studies performed in secondary and reclaimed effluents (Mandilara et al. 2006; Costán-Longares et al. 2008) and indicate that among the indicators evaluated there is only a high (strong) and also significant correlation between *E. coli* and fecal enterococi.

Therefore, the bacterial indicators do not adequately reflect the removal of either pathogenic viruses or protozoa achieved in disinfection procedures used to obtain the reclaimed effluent and, in order to evaluate the microbiological risk of the use of the reclaimed effluent, it is necessary to analyze the three types of indicator microorganisms (bacteria, virus and protozoa).

CONCLUSIONS

The results obtained show that the reclamation treatments evaluated present different efficiencies in indicator microorganism removal depending on the type of microorganism, while the WWTP treatments present a similar removal for all the indicators evaluated.

The average removal of *E. coli* and the fecal enterococci was higher than that of somatic bacteriophages and sulfite-reducing clostridia in the reclamation treatments evaluated. This confirms the great resistance of virus and spores to chlorination at the dose evaluated in this study.

The Spearman's correlations indicate that there are no significant correlations between bacterial indicators and somatic bacteriophages, and between bacterial indicators and spores of sulfite-reducing clostridia. Therefore, it is not suitable to use any of the bacterial indicators evaluated to predict the content of virus or spores of sulfite-reducing clostridia and it is recommended to include the monitoring of the three types of indicator microorganisms (bacteria, virus and protozoa) in order to evaluate the microbiological quality of the reclaimed effluent.

It has to be taken into account that the operational regime of the WRP can affect the microbiological quality of the reclaimed effluent.

In respect to the 'legal' content of the reclaimed effluent, it should be noted that this resource can be reused for several purposes.

ACKNOWLEDGMENTS

The authors acknowledge the financial support from the CENIT project SOSTAQUA and the University and Research Grants and Fellowships Agency (AGAUR) of the Government of Catalonia.

REFERENCES

- Angelakis, A. N., Bontoux, L. & Lazarova, V. 2005 Main challenges and prospective for water recycling and reuse in EU countries. *Water Sci. Technol.: Water Supply* **3** (4), 59–68.
- APHA 2005 *Standard Methods for the Examination of Water and Wastewater*. American Public Health Association/American Water Works Association/Water Environment Federation, Washington, DC. Available from: <http://www.standardmethods.org/>.
- Araujo, M., Sueiro, R. A., Freire, B., Gómez, M. J. & Garrido, M. J. 2004 Enumeration of *Clostridium perfringens* spores in groundwater samples: comparison of six culture media. *J. Microbiol. Methods* **57**, 175–180.
- Asano, T. 2002 Water from (waste)water – the dependable water resource. *Water Sci. Technol.* **45**, 24–33.
- Ashbolt, N. J., Grabow, W. O. K. & Snozzi, M. 2001 Indicators of microbial water quality. In: *Water Quality: Guidelines, Standards and Health; Risk Assessment and Management for Water-related Infectious Disease* (L. Fewtrell & J. Bartram, eds). IWA Publishing, London.
- Costán-Longares, A., Montemayor, M., Payán, A., Méndez, J., Jofre, J., Mujeriego, R. & Lucena, F. 2008 Microbial indicators and pathogens: removal, relationships and predictive capabilities in water reclamation facilities. *Water Res.* **42** (17), 4439–4448.
- Duran, A. E., Muniesa, M., Mocé-Llivina, L., Campos, C., Jofre, J. & Lucena, F. 2003 Usefulness of different groups of bacteriophages as model microorganisms for evaluating chlorination. *J. Appl. Microbiol.* **95** (1), 29–37.
- Gantzer, C., Maul, A., Audic, J. M. & Schwartzbrod, L. 1998 Detection of infectious enteroviruses, enterovirus genomes, somatic bacteriophages, and *Bacteroides fragilis* phages in treated wastewater. *Appl. Environ. Microbiol.* **64** (11), 4307–4312.
- Harwood, V. J., Levine, A. D., Scott, T. M., Chivukula, V., Lukasik, J., Farrah, S. R. & Rose, J. B. 2005 Validity of the indicator organism paradigm for pathogen reduction in reclaimed water and public health protection. *Appl. Environ. Microbiol.* **71** (6), 3163–3170.
- Havelaar, A. H. 1987 Bacteriophages as model organisms in water treatment. *Microbiol. Sci.* **4** (12), 362–364.
- IAWPRC (Study Group on Health Related Water Microbiology) 1991 Bacteriophages as model viruses in water quality control. *Water Res.* **25** (5), 529–545.

- ISO (International Organization for Standardization) 2000 *Water Quality-detection and Enumeration of Bacteriophages. Part 2: Enumeration of Somatic Bacteriophages*. ISO 10705-2. International Organization for Standardization, Geneva.
- Kott, Y., Roze, N., Sperber, S. & Betzer, N. 1974 **Bacteriophages as viral pollution indicators**. *Water Res.* **8**, 165–171.
- Lucena, F. 2008 Los bacteriófagos de bacterias entéricas. Una herramienta útil para el seguimiento de los tratamientos de desinfección en aguas regeneradas. Jornadas ESAMUR, Murcia, Spain.
- Lucena, F., Duran, A. E., Morón, A., Calderon, E., Campos, C., Gantzer, C. & Skraber, S. 2004 **Reduction of bacterial indicators and bacteriophages infecting faecal bacteria in primary and secondary wastewater treatments**. *J. Appl. Microbiol.* **97**, 1069–1076.
- Mandilara, G. D., Smeti, E. M., Mavridou, A. T., Lambiri, M. P., Vatopoulos, A. C. & Rigas, F. P. 2006 **Correlation between bacterial indicators and bacteriophages in sewage and sludge**. *FEMS Microbiol. Lett.* **263**, 119–126.
- Méndez, J., Audicana, A., Isern, A., Llana, J., Moreno, B., Tarancon, M. L., Jofre, J. & Lucena, F. 2004 **Standardised evaluation of the performance of a simple membrane filtration-elution method to concentrate bacteriophages from drinking water**. *J. Virol. Methods* **117**, 19–25.
- Payment, P., Trudel, M. & Plante, R. 1985 Elimination of viruses and indicator bacteria at each step of treatment during preparation of drinking water at seven water treatment plants. *Appl. Environ. Microbiol.* **49** (6), 1418–1428.
- RD 1620/2007 Real Decreto, de 7 de diciembre, por el que se establece el régimen jurídico de la reutilización de las aguas depuradas. BOE num. 294. Available from: <http://www.boe.es/boe/dias/2007/12/08/pdfs/A50639-50661.pdf>.
- Rose, J. B., Dickson, L. J., Farrah, S. R. & Carnahan, R. P. 1996 **Removal of pathogenic and indicator microorganisms by a full-scale water reclamation facility**. *Water Res.* **30** (11), 2785–2797.
- Scott, T. M., McLaughlin, M. R., Harwood, V. J., Chivukula, V., Levine, A., Gennaccaro, A., Lukasik, J., Farrah, S. R. & Rose, J. B. 2003 Reduction of pathogens, indicator bacteria, and alternative indicators by wastewater treatment and reclamation processes. *Water Sci. Technol.: Water Supply* **3** (4), 247–252.
- Sobsey, M. D., Svhwab, K. J. & Handzel, T. R. 1982 A simple membrane filter method to concentrate and enumerate male-specific RNA coliphages. *J. Am. Water Works Assoc.* **9**, 52–59.
- Tartera, C., Bosch, A. & Jofre, J. 1988 **The inactivation of bacteriophages infecting *Bacteroides fragilis* by chlorine treatment and UV irradiation**. *FEMS Microbiol. Lett.* **56**, 313–316.
- Tchobanoglous, G., Burton, F. L. & Stensen, H. D. 2003 *Wastewater Engineering, Treatment and Reuse*. Metcalf & Eddy Inc., McGraw-Hill, New York.
- Toze, S. 2006 **Reuse of effluent water – benefits and risks**. *Agric. Water Manage.* **80**, 147–159.
- USEPA (United States Environmental Protection Agency) 2004 *Guidelines for Water Reuse*. EPA/625/R-04/108. US Environmental Protection Agency, Washington, DC. Available from: <http://www.epa.gov/ord/NRMRL/pubs/625r04108/625r04108.pdf>.
- Wen, Q., Tutuka, C., Keegan, A. & Jin, B. 2009 **Fate of pathogenic microorganisms and indicators in secondary activated sludge wastewater treatment plants**. *J. Environ. Manage.* **90** (3), 1442–1447.
- WHO (World Health Organization) 2006 *Guidelines for the Safe Use of Wastewater, Excreta and Greywater*. WHO, Geneva.

First received 22 November 2011; accepted in revised form 14 August 2012. Available online 9 October 2012