

# Assessment of the technological reliability of a hybrid constructed wetland for wastewater treatment in a mountain eco-tourist farm in Poland

Andrzej Jucherski, Maria Nastawny, Andrzej Walczowski, Krzysztof Józwiakowski and Magdalena Gajewska

## ABSTRACT

The aim of the present study was to assess the technological reliability of a domestic hybrid wastewater treatment installation consisting of a classic three-chambered (volume 6 m<sup>3</sup>) septic tank, a vertical flow trickling bed filled with granules of a calcinated clay material (KERAMZYT), a special wetland bed constructed on a slope, and a permeable pond used as a receiver. The test treatment plant was located at a mountain eco-tourist farm on the periphery of the spa municipality of Krynica-Zdrój, Poland. The plant's operational reliability in reducing the concentration of organic matter, measured as biochemical oxygen demand (BOD<sub>5</sub>) and chemical oxygen demand (COD), was 100% when modelled by both the Weibull and the lognormal distributions. The respective reliability values for total nitrogen removal were 76.8% and 77.0%, total suspended solids – 99.5% and 92.6%, and PO<sub>4</sub>-P – 98.2% and 95.2%, with the differences being negligible. The installation was characterized by a very high level of technological reliability when compared with other solutions of this type. The Weibull method employed for statistical evaluation of technological reliability can also be used for comparison purposes. From the ecological perspective, the facility presented in the study has proven to be an effective tool for protecting local aquifer areas.

**Key words** | cold climate, hybrid constructed wetland, mountain aquifers, rural areas, technological reliability

**Andrzej Jucherski**  
**Maria Nastawny**  
**Andrzej Walczowski**  
 Mountain Centre of Studies and Implementations  
 in Tylicz,  
 Institute of Technology and Life Sciences in  
 Falenty,  
 Pułaskiego St. 25A,  
 33-383 Tylicz,  
 Poland

**Krzysztof Józwiakowski** (corresponding author)  
 Department of Environmental Engineering and  
 Geodesy,  
 University of Life Sciences in Lublin,  
 Leszczyńskiego 7,  
 20-069 Lublin,  
 Poland  
 E-mail: krzysztof.jozwiakowski@up.lublin.pl

**Magdalena Gajewska**  
 Department of Water and Wastewater Technology,  
 Gdańsk University of Technology,  
 Narutowicza st. 11/12,  
 80-233 Gdańsk,  
 Poland

## INTRODUCTION

Evaluation of the technological reliability of individual wastewater treatment systems should be an important part of planning and decision-making in water and wastewater management, particularly now, when a wide range of technological solutions are available (Józwiakowski *et al.* 2015). Reliable operation of wastewater treatment units must be ensured due to both environmental and human health protection concerns (Eisenberg *et al.* 2001; Wojciechowska *et al.* 2016). Reliable operation of domestic wastewater treatment plants (WWTPs) is especially important in mountain aquifer areas, which are very sensitive to pollution. Mountainous regions in Poland play a key role in developing and sustaining vital socio-economic and environmental functions, which intertwine in the activities of spa and tourist resorts, forest management, environment-friendly farming and especially in hydrology. Although Polish mountainous areas have a high water production potential, as manifested by an almost

40% regional surplus in relation to the water discharged by all the rivers, Poland occupies one of the last positions in Europe in terms of the total freshwater resources, which are estimated at 1,630 m<sup>3</sup>·year<sup>-1</sup>·person<sup>-1</sup>. Therefore, it is essential that groundwater and the upper reaches of local streams and mountain rivers should be protected against biological, chemical and bacteriological pollution resulting from the discharge of untreated domestic sewage to the environment in rural areas. One of the key issues in technological progress in wastewater management in rural, environmentally valuable areas is the construction of small domestic or local WWTPs with a high, long-term reliability and effectiveness in reducing wastewater pollutions (Jucherski & Walczowski 2012; Masi *et al.* 2013; Gajewska *et al.* 2015; Józwiakowski *et al.* 2016).

Nowadays, more and more innovative wastewater treatment systems are being designed and offered on the market,

which spurs the need for developing a universal method of assessing the reliability of the various treatment processes and facilities. Such a method would be helpful in planning and comparing the levels of protection offered by the various technologies (Jóźwiakowski *et al.* 2015).

The methods for determining the reliability of individual wastewater treatment systems have been described in more detail by Eisenberg *et al.* (2001). Lately, Djeddou & Achour (2015) have proposed a method for predicting reliability using artificial neural networks.

A comprehensive and useful assessment of the reliability of domestic WWTPs should be based on a series of measurements and observations of treatment variability under normal and critical operating conditions as well as the probability of mechanical failures and their impact on the quality of the treated wastewater (Eisenberg *et al.* 2001).

Reliability is defined as the probability of achieving required performance of a WWTP over a specific time and under specific conditions (Oliveira & Sterling 2008). To assess WWTP, a coefficient of reliability which relates mean pollutant concentrations to effluent standards (Niku *et al.* 1982) can also be used.

The statistical step in the assessment of WWTP reliability presented in this article is based on the normal (Niku *et al.* 1982), the lognormal (Oliveira & Sterling 2008) and the Weibull distributions (Wałęga 2009; Bugajski *et al.* 2012; Nastawny & Jucherski 2013). Statistical distributions of probability are used to establish the probability of occurrence of selected values of pollutants. Recent findings reported in the literature (Wałęga 2009; Bugajski *et al.* 2012; Bugajski 2014; Nastawny & Jucherski 2013) show that the Weibull distribution is an accurate and precise tool for evaluation of WWTP reliability.

Systems for domestic wastewater management are individual facilities with technical and quasi-technical treatment devices designed to collect and treat wastewater to the extent required by specific regulations (Regulation of the Polish Minister of Environment 2014) as well as discharge it to receivers without adversely affecting the soil–water

complex in the place where the facilities are located. In rural areas, individual treatment facilities usually operate without constant supervision and are therefore particularly exposed to fluctuations in efficiency due to a variable load pattern (Platzer & Mauch 1997; Massoud *et al.* 2009); in consequence, the quality of effluent often does not meet the requirements stipulated in the regulations in force.

Hybrid wetland systems have recently been more and more frequently used for the treatment of domestic wastewater from museum buildings and forester or mountain shelters, including those located in national parks. When well designed and properly maintained, they can achieve high pollutant removal efficiencies (Masi *et al.* 2007; Osaliya *et al.* 2011; Jóźwiakowski *et al.* 2014, 2016; Sanchez-Ramos *et al.* 2015; Gizińska-Górna *et al.* 2016). The literature, however, provides little data on the reliability of pollutant removal processes in such constructed wetland systems (CWS) over long periods (years) of operation.

The aim of the present study was to assess the range of long-term fluctuations in treatment reliability in a domestic hybrid WWTP. The plant had been built over 10 years before on an eco-tourist farm in the mountain municipality and spa of Krynica-Zdrój in Poland and had been continuously operating since that time. The following indicators of wastewater contamination were measured: (i) biochemical oxygen demand (BOD<sub>5</sub>) and chemical oxygen demand (COD) for contamination with organic matter, (ii) total suspended solids (TSS), (iii) total nitrogen (TN), and (iv) phosphorus PO<sub>4</sub>-P. The indicators' results (pollutant concentrations) were compared with the Polish standards for treated wastewater (Regulation of the Polish Minister of Environment 2014) discharged into water and soil from treatment plants below 2000 PE.

## MATERIAL AND METHODS

The subject of the study was a hybrid WWTP described in detail by Jucherski & Walczowski (2012). The plant was operated by an eco-tourist farm located in the rural

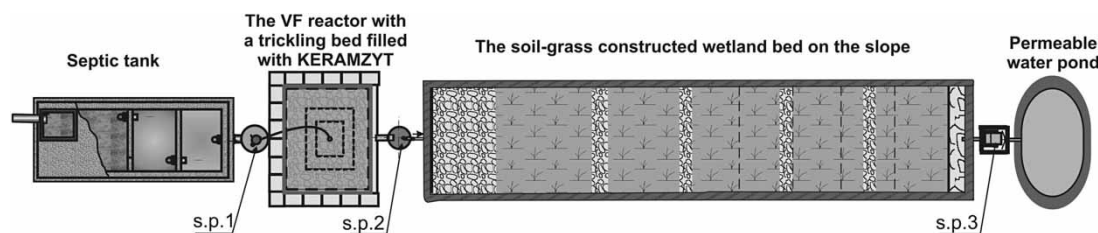


Figure 1 | Schematic of the wastewater treatment installation (sampling points: s.p.1, s.p.2, s.p.3).

**Table 1** | Basic statistics for pollutant concentrations in wastewater

Parameter	Number of samples	Mean mg·dm <sup>-3</sup>	Median mg·dm <sup>-3</sup>	Minimum mg·dm <sup>-3</sup>	Maximum mg·dm <sup>-3</sup>	Standard deviation mg·dm <sup>-3</sup>	Coefficient of variation %
BOD <sub>5</sub>							
inlet	57	271.7	230	90	580	132.9	48.8
outlet	49	3.49	2.5	0	13	2.92	83.6
COD							
inlet	61	391	353	214	641	114.9	29.4
outlet	55	28	25	5	112	17.6	63
Suspended solids							
inlet	48	75.4	66	19	218.6	40.5	53.7
outlet	41	15.8	14	0	44.6	10.9	69.2
TN N <sub>tot</sub>							
inlet	61	110.5	105.5	70.3	193.8	19.5	17.6
outlet	55	20.9	19.5	1.6	64.8	16.4	78.5
Phosphorus PO <sub>4</sub> -P							
inlet	65	12.3	11.1	7.6	24.9	3.97	32.3
outlet	59	1.7	1.5	0.14	5.46	1.23	72.2

peripheries of the spa town of Krynica-Zdrój, Poland. The plant had been monitored over the years 2005–2015. A schematic of the facility with the sampling points is presented in Figure 1.

The installation consisted of a classic three-chamber septic tank, a vertical flow (VF) reactor (filter) followed by a special constructed wetland, and a permeable water pond as a receiver of the final effluent. The septic tank, with a capacity of 6 m<sup>3</sup>, was a monolithic concrete structure designed to receive sewage with a seasonal variability from 3 to 15 persons (with an average of PE = 5). The substrate used in the VF reactor were granules of a sintered clay material (KERAMZYT). To improve biological treatment and nitrification at the vertical stage, the wastewater was sprayed onto the surface of the reactor. Due to the harsh


climate, it was necessary to use a cover to insulate the reactor from freezing in winter. Downstream of the reactor, there was a special filter bed (wetland) with subsurface flow, planted with a mix of reed sweet grass (*Glyceria maxima*), reed canary grass (*Phalaris arundinacea*) and other grasses spontaneously inhabiting the bed. The bed was constructed on a slope for tertiary treatment and removal of the remaining nutrients (N and P). The installation ended with a permeable pond for receiving and infiltration of the treated wastewater into the soil complex surrounding the treatment unit.

The average hydraulic load of the treatment plant in the investigation period was 621.2 dm<sup>3</sup> day<sup>-1</sup>, and the average concentrations of pollutants in raw sewage were 271.7 mg O<sub>2</sub>·dm<sup>-3</sup> for BOD<sub>5</sub>, 390.8 mg O<sub>2</sub>·dm<sup>-3</sup> for COD, 75.4 mg·dm<sup>-3</sup> for total suspended solids, 110.5 mg·dm<sup>-3</sup> for

**Table 2** | The Kolmogorov-Smirnov goodness-of-fit statistics and significance levels for the analyzed empirical distributions

Distribution	Normal		Lognormal		Weibull	
	stat	p	stat	p	stat	p
BOD <sub>5</sub>	0.2076	0.0324	0.1118	0.5751	0.1354	0.3371
COD	0.1388	0.2183	0.0970	0.6427	0.1157	0.4208
TSS	0.0944	0.8454	0.1416	0.3786	0.1067	0.7262
TN N <sub>tot</sub>	0.1422	0.1960	0.1604	0.1056	0.1085	0.5028
Phosphorus PO <sub>4</sub> -P	0.1093	0.4501	0.0926	0.6585	0.0507	0.9962

Symbols: stat – value of the statistic test, p – significance level of the test; when p is greater than 0.05, the distribution of empirical data can be described by the analyzed distribution.

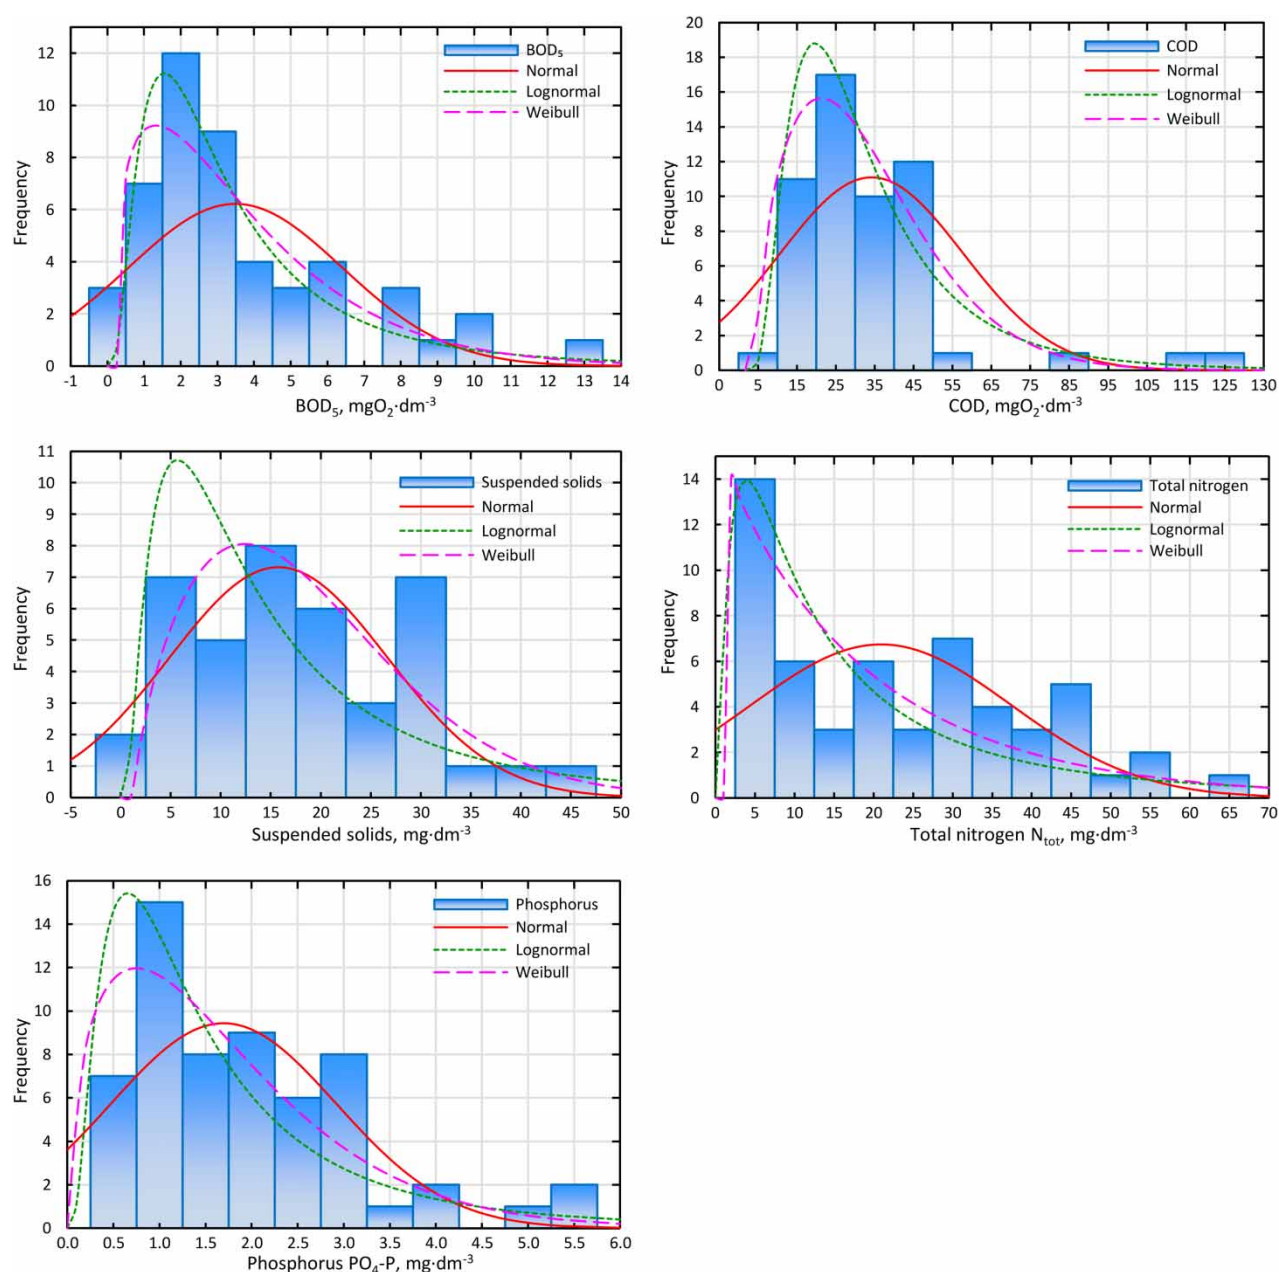

**Figure 2** | Histograms of the normal, lognormal and Weibull distributions of the empirical data.

TN, and 12.3 mg·dm<sup>-3</sup> for phosphorus PO<sub>4</sub>-P (Table 1). The flow of treated wastewater was calculated based on the water consumption reading of a water meter. BOD<sub>5</sub> was determined using the OxiTop respirometric measuring system from WTW. COD, TN and phosphate phosphorus were determined using a Merck SQ118 photometer and a Merck thermoreactor TR-200. The total suspended solids were determined by a gravimetric method, in accordance with the standard PN-72/C-04559/02.

The statistical analysis was based on the normal, lognormal and Weibull distributions. Statistica v. 13.0 software was employed to define the characteristics of the distribution of the empirical data using the Kolmogorov–Smirnov goodness-of-fit test. Data were tested for normality of distribution by measuring the distance between the empirical distribution and the theoretical distribution. The following null hypothesis was tested at 0.05 level of significance: distribution of the variable is normal/lognormal/Weibull.

Furthermore the quality of fit of the Weibull distribution to empirical data was assessed using the Hollander–Proschan test for the significance level of 0.05. The reliability function  $R(x)$  was calculated as a complement to the cumulative distribution function using the following formula:

$$R(x) = 1 - F(x) \quad (1)$$

where  $x$  is an indicator of the concentration of pollutants in treated wastewater (Bugajski et al. 2012).

Reliability was determined from cumulative distribution plots, taking into consideration pollutant concentrations in treated wastewater permitted by the Regulation of the Polish Minister of Environment (2014), i.e.:  $BOD_5 \leq 40 \text{ mg O}_2\cdot\text{dm}^{-3}$ ,  $COD \leq 150 \text{ mg O}_2\cdot\text{dm}^{-3}$ , total suspended solids  $\leq 50 \text{ mg}\cdot\text{dm}^{-3}$ ,  $TN \leq 30 \text{ mg}\cdot\text{dm}^{-3}$ , total phosphorus  $\leq 5 \text{ mg}\cdot\text{dm}^{-3}$ .

## RESULTS AND DISCUSSION

The many-year means of effluent contaminant concentrations in wastewater treated in the investigated installation ( $BOD_5 - 3.49 \text{ mg O}_2\cdot\text{dm}^{-3}$ ,  $COD - 28.0 \text{ mg O}_2\cdot\text{dm}^{-3}$ , suspended solids  $- 15.8 \text{ mg}\cdot\text{dm}^{-3}$ ,  $TN - 20.9 \text{ mg}\cdot\text{dm}^{-3}$ , and phosphorus  $P\text{-PO}_4 - 1.70 \text{ mg}\cdot\text{dm}^{-3}$ ) (Table 1) were much lower than required by the Regulation (2014) on discharging wastewater into the soil or surface waters including lakes and their tributaries, and artificial water reservoirs situated on flowing waters.

Table 1 shows the basic statistics for pollutant concentration in wastewater.

The effluent quality indicators were characterized by high coefficients of variation (Table 1), which, though statistically significant (and therefore useful for the evaluation of the treatment processes in the installation), were too low to have any relevance from the point of view of environmental protection. To determine the technological reliability of the treatment plant, a detailed statistical analysis was performed based on the distributions of the empirical data of each effluent contaminant. The normal, lognormal and Weibull distributions (Table 2, Figure 2) were adjusted to data sets obtained during the 10-year study.

Statistical analysis using the Kolmogorov–Smirnov goodness-of-fit test showed that the Weibull and lognormal distributions could be well fitted to the empirical distributions of each pollution indicator, whereas the normal distribution gave a much worse fit, although it could also be used for most of the parameters, except  $BOD_5$  (Table 2).

Based on the detailed analysis and evaluation of the WWTP, as reported above, its reliability was modelled

**Table 3** | Parameters of the Weibull distribution and the Hollander–Proschan goodness-of-fit test

Parameter	Parameters of Weibull distribution			Hollander–Proschan goodness-of-fit test	
	Location	Shape	Scale	stat	p
$BOD_5$	0.3182	1.2479	3.6602	0.2150	0.8297
COD	2.4697	1.5798	28.5112	0.0200	0.9840
Suspended solids	−0.6212	1.6638	19.2133	−0.1235	0.9017
$TN N_{tot}$	1.2364	0.9844	19.5929	−0.3558	0.7220
Phosphorus $PO_4\text{-P}$	0.0707	1.3664	1.7796	0.0411	0.9672


Symbols: stat – value of the statistic test, p – significance level of the test; when  $p \leq 0.05$  the distribution of data is not Weibull distribution.

using the Weibull distribution (Table 3, Figure 3). This allowed us to compare our results with those obtained by other authors (Wałęga 2009; Bugajski et al. 2012; Nastawny & Jucherski 2013) who had used the same distribution. In addition, the indicators of the technological reliability of the treatment plant were compared with values obtained from the lognormal distribution. The parameters of the Weibull distribution were calculated using the maximum likelihood estimation. In order to determine the goodness of fit of the Weibull distribution to the empirical data described by the distribution parameters (Table 3), the Hollander–Proschan test was applied. As can be seen from Table 3, the goodness of fit of the obtained distributions was high and ranged from 72 to 98% at a significance level of 0.05 (Table 3).

The technological reliabilities of the installation determined by the Weibull distribution function compared with the lognormal distribution are given in Table 4. It was shown that the reliability of reducing  $BOD_5$  and COD concentrations was 100% for both the lognormal as well as the Weibull distribution functions. For other pollutants, the reliabilities of the treatment plant described by the lognormal distribution and the Weibull distribution were slightly lower at 92.6% and 99.5% for TSS, 77.0% and 76.8% for  $N_{tot}$ , and 95.2% and 98.2% for phosphorus  $PO_4\text{-P}$ , respectively (Figure 3, Table 4).

The results of this study demonstrate that the wastewater treatment processes were stable and reliable as well as very effective. As shown by the graphs in Figure 4 and the Helsinki Commission Recommendation (HELCOM 2007) data in Table 5, the average values of the parameters of the treated wastewater met the Polish requirements (Regulation of the Polish Minister of Environment 2014).



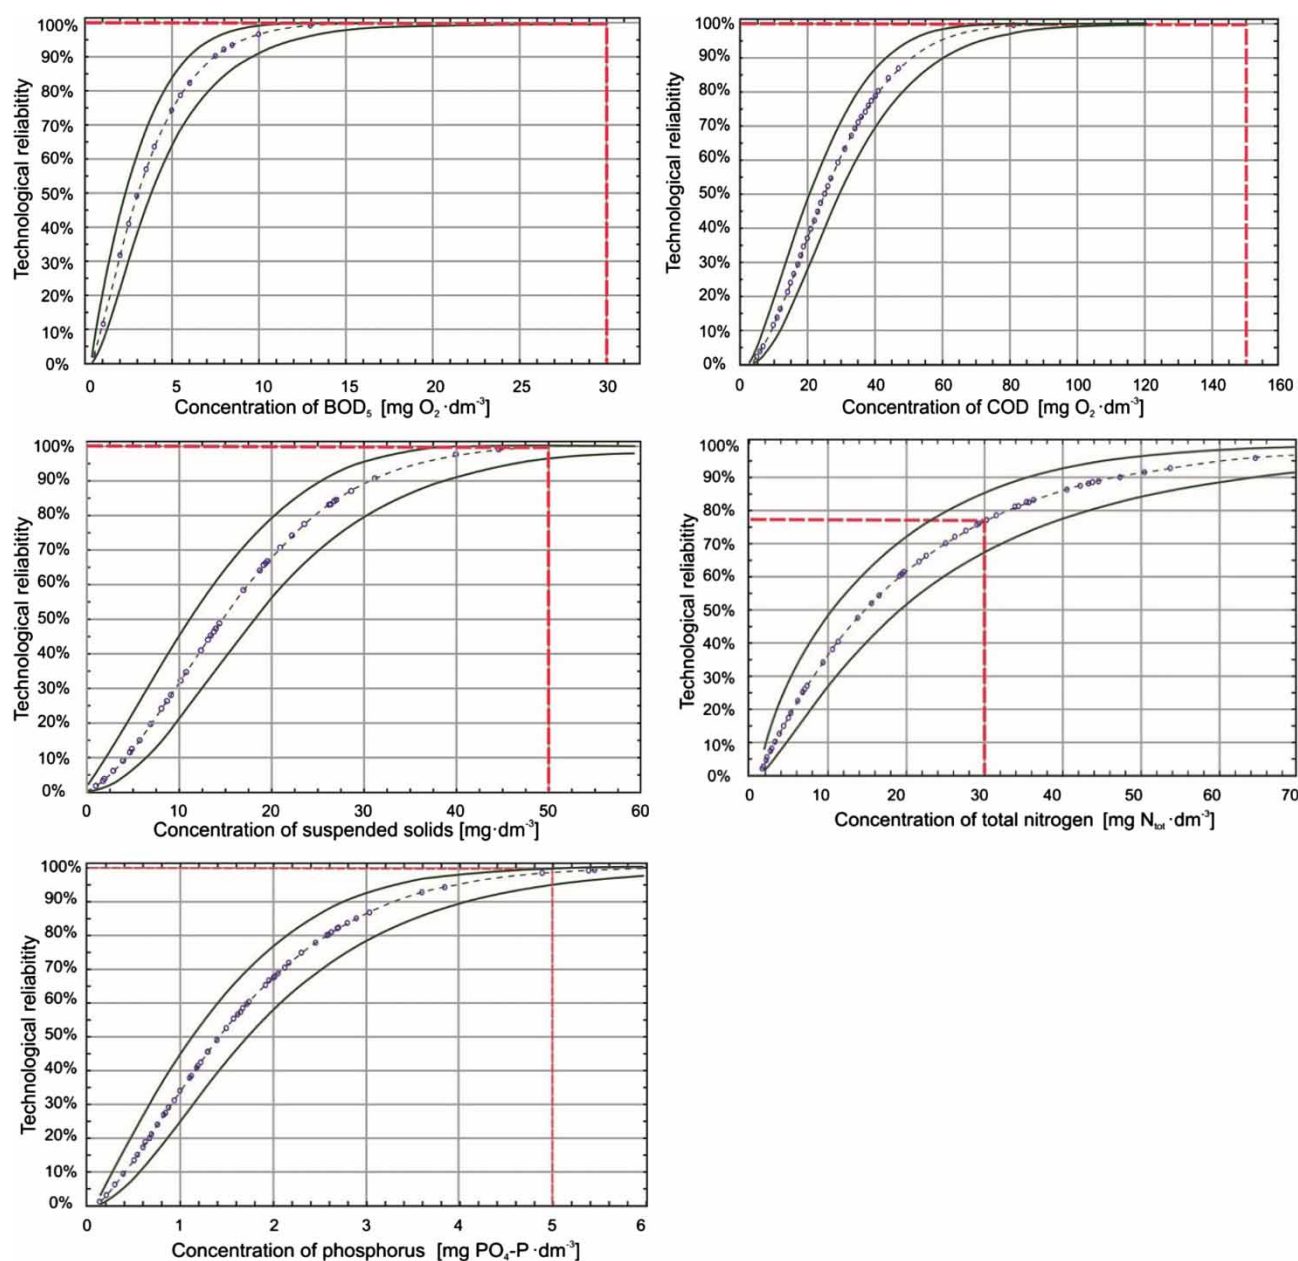


**Figure 3** | Weibull cumulative distribution functions and the technological reliabilities determined for each pollution parameter with estimated confidence intervals of 95.0%.

**Table 4** | The technological reliability of the facility for wastewater treatment (in %) determined using the Weibull and the lognormal distribution functions

Parameter	Weibull distribution	Lognormal distribution
BOD <sub>5</sub>	100	100
COD	100	100
Suspended solids	99.5	92.6
TN N <sub>tot</sub>	76.8	77.0
Phosphorus PO <sub>4</sub> -P	98.2	95.2

Therefore, treated wastewater could be discharged into the environment throughout the year, with soil receiver sites being preferred over other receiver bodies.

Compared with the technological reliabilities of domestic WWTPs evaluated by other authors (Walega *et al.* 2008; Bugajski *et al.* 2012), the installation investigated in this study was much more efficient and reliable as far as the removal of pollutants was concerned. The reliability of reducing the levels of organic matter in wastewater was

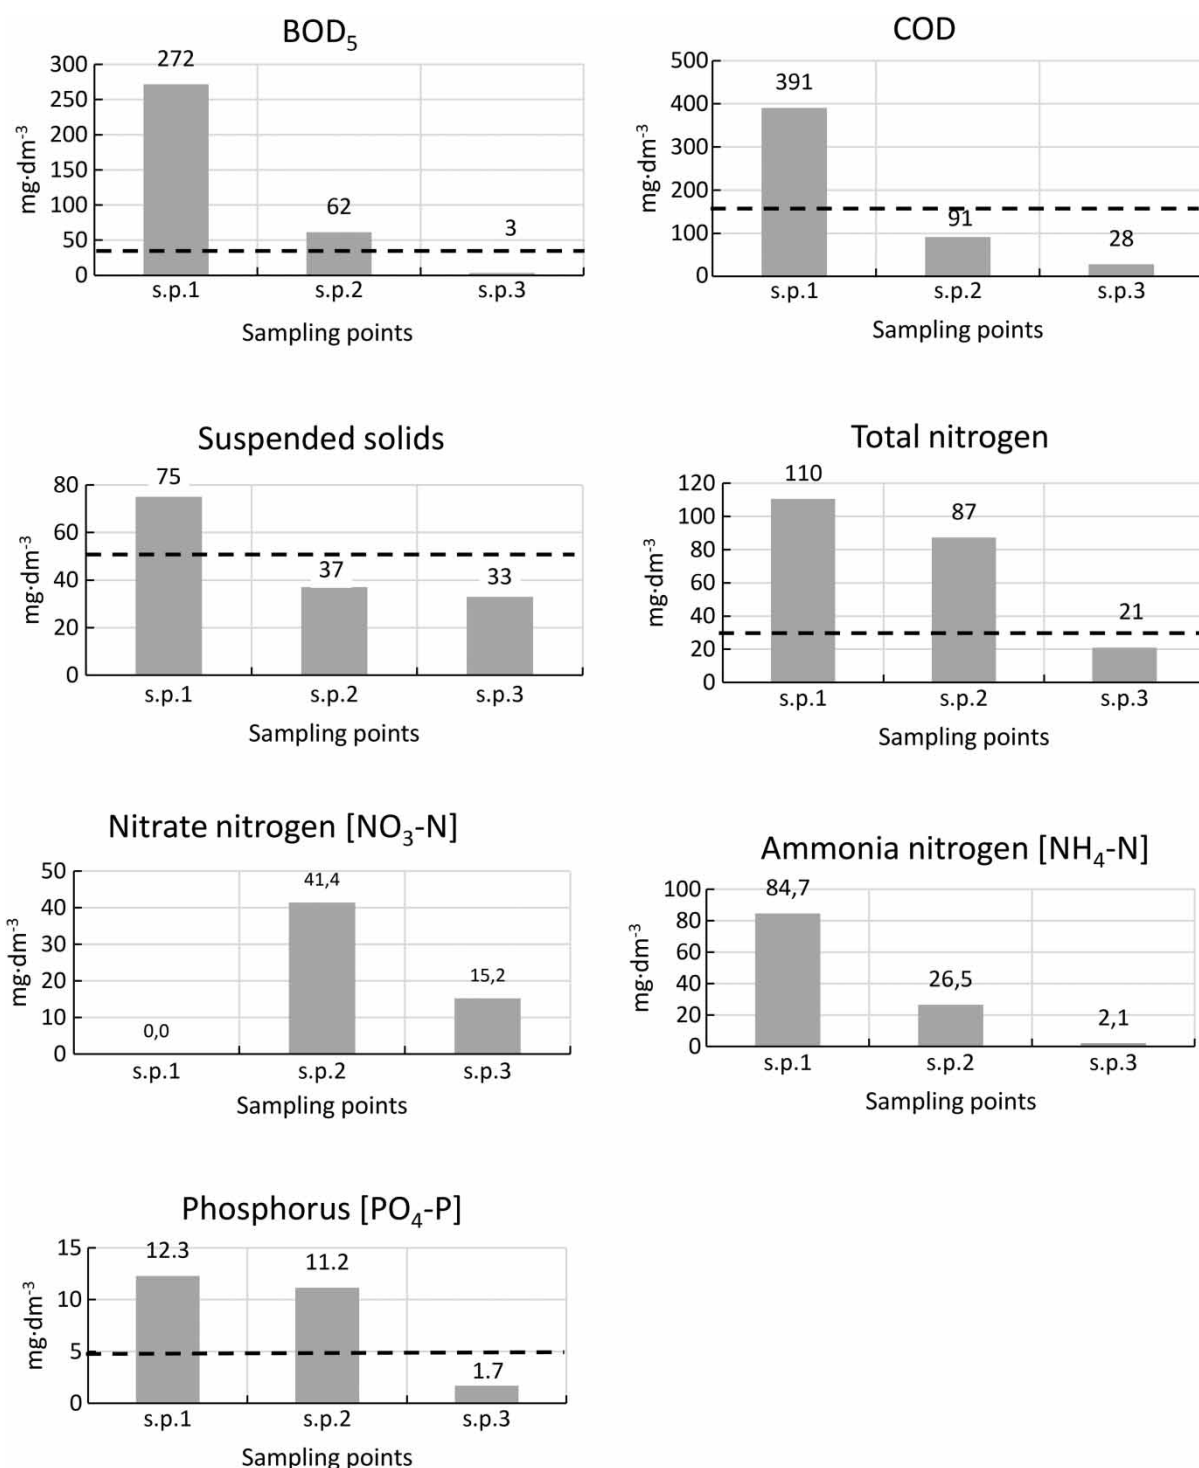

**Figure 4** | Dynamics of reduction of the mean pollutant concentrations in the successive treatment steps.

100% for BOD<sub>5</sub> and COD and more than 92% for suspended solids. The corresponding values for the treatment plant Biocompact BCT S-12 (with activated sludge) were 68% (BOD<sub>5</sub>), 88% (COD) and 62% (suspended solids)

(Bugajski *et al.* 2012). In the case of the domestic treatment plant RetroFAST (with an aerated biological filter), the reliability values were 85%, 89% and 92%, respectively (Wałęga *et al.* 2008). Wastewater from individual rural

**Table 5** | The specific loads of pollutants in treated wastewater – median values (g-PE<sup>-1</sup>·d<sup>-1</sup>)

Specification	Sampling points		
	s.p.1	s.p.2	s.p.3
BOD <sub>5</sub>	35	7	0.4 <sup>a</sup>
COD	354	13	3.8
N <sub>tot</sub>	16.0	13.4	3.0 <sup>a</sup>
NH <sub>4</sub> -N	12.6	3.8	0.06
PO <sub>4</sub> -P	1.7	1.5	0.23 <sup>a</sup>

<sup>a</sup>HELCOM Recommendation 28E/6 (2007): BOD<sub>5</sub>, 8 g-PE<sup>-1</sup>·d<sup>-1</sup>; N<sub>tot</sub>, 10 g-PE<sup>-1</sup>·d<sup>-1</sup>; P<sub>tot</sub>, 0.65 g-PE<sup>-1</sup>·d<sup>-1</sup>.

households collected in septic tanks is characterized by several times higher concentrations of pollutants than wastewater discharged by municipal sewage systems. The results of a two-year monitoring study of the quality of wastewater, conducted in one of Polish villages, are shown in Table 6.

Due to this fact, the technological set up of a single-family WWTP (below 50 PE) needs to be characterized by a very high pollutant removal efficiency as well as a very high resistance to these fluctuations. Such requirements are practically impossible to meet using container WWTPs with activated sludge or trickling filters. By contrast, hybrid systems equipped with beds built as treatment wetlands can easily adapt to such fluctuations and ensure stable removal of pollutants from wastewater.

As far as BOD<sub>5</sub> and COD are concerned, the analyzed installation worked without technological failures over the whole 10-year study period. For suspended solids, the probability of occurrence of failure events (effluent quality parameters higher than permitted) was two days per year and for phosphorus seven days per year. The technological reliability of TN removal was much lower (76.8%), with as many as 85 failure days during the whole year. The hybrid

treatment plant had operated continuously for more than 10 years and had been maintained to ensure constant operational availability. The yearly removal efficiency of pollutants was sensitive only to a slight periodic variability of both hydraulic and pollution loads caused by tourists staying at the farm during vacation periods. The plant had never been observed to freeze in winter thanks to the snow cover, and the only decrease in average efficiency in the cold season concerned the removal of N<sub>tot</sub> (18%) (Jucherski & Walczowski 2012). These malfunctions occurred in winter, when the weather conditions were not conducive to efficient denitrification of NO<sub>3</sub>-N, which was the dominant form of nitrogen in the effluent (Figure 4). By contrast, the installation showed a very high rate of conversion of ammonium nitrogen. The average concentration of NH<sub>4</sub>-N did not exceed 2.1 mg·dm<sup>-3</sup> over the entire research period. In order to increase the efficiency of tertiary wastewater treatment in winter seasons and thereby improve the overall pollutant removal efficiency of the WWTP, further efforts have to be made at re-designing and re-building the existing filter bed.

To summarize, the installation tested can be particularly recommended for use in mountainous regions, where streams and rivers as well as underground waters are very sensitive to pollution and, therefore, require higher levels of protection. The high reliability of this type of WWTPs is a consequence of the application of a hybrid configuration of facilities, which is characterized by an increased technological inertia in the multi-staged wastewater treatment process (Jucherski 2007). The number and configuration of the facilities constituting the wastewater treatment installation have been chosen so as to ensure the stability of the process under changeable weather conditions and variable pollutant loads in raw wastewater. The advantages of the investigated installation include simple operation, low power consumption and low operating costs. One disadvantage is that, compared with a container WWTP, the system occupies a slightly larger surface area, which, however,

**Table 6** | Data on pollutant concentrations in wastewater outflowing from septic tanks in a village in Poland. A two-year monitoring study

Parameter	Number of samples	Mean mg dm <sup>-3</sup>	Median mg dm <sup>-3</sup>	Minimum mg dm <sup>-3</sup>	Maximum mg dm <sup>-3</sup>	Standard deviation mg dm <sup>-3</sup>	Coefficient of variation %	Mean values in municipal wastewater mg dm <sup>-3</sup>
BOD <sub>5</sub>	147	521.1	460.0	100.0	1,300.0	236.0	45.3	197
COD	149	866.3	811.0	251.0	1,754.0	295.6	34.1	393
Suspended solids	149	205.5	140.0	45.6	3,060.0	272.9	132.8	116
TN N <sub>tot</sub>	149	150.1	145.7	28.3	323.5	50.1	33.4	36
Ammonia nitrogen NH <sub>4</sub> -N	149	109.9	101.9	18.4	280.1	40.3	36.7	25
Phosphorus PO <sub>4</sub> -P	149	16.5	15.9	2.5	30.7	5.3	32.1	6



does not limit its application, especially in rural (Nastawny & Jucherski 2013) or protected areas (Jóźwiakowski et al. 2014; Jóźwiakowski et al. 2016). The design and structure of the test facility make it especially suitable for use in sloping terrain with large inclines typical of mountainous regions.

## CONCLUSIONS

This study showed that the technological solutions applied in the investigated installation for the treatment of wastewater produced by an eco-tourist mountain farm proved to be very effective and reliable during the whole 10-year period of operation. The long-term median concentration values of effluent pollutants ( $\text{BOD}_5$  –  $2.5 \text{ mg O}_2 \cdot \text{dm}^{-3}$ ,  $\text{COD}$  –  $25.0 \text{ mg O}_2 \cdot \text{dm}^{-3}$ ,  $\text{N}_{\text{tot}}$  –  $19.5 \text{ mg} \cdot \text{dm}^{-3}$ ,  $\text{PO}_4\text{-P}$  –  $1.5 \text{ mg} \cdot \text{dm}^{-3}$  and suspended solids –  $14.0 \text{ mg} \cdot \text{dm}^{-3}$ ) were lower than permitted by the Polish Regulation (Regulation of the Minister of Environment 2014). At the same time, the specific loads of pollutants in the effluent were much lower than those specified in the HELCOM Recommendation.

The technological reliability of the tested installation (100% for both  $\text{BOD}_5$  and  $\text{COD}$  removal, over 90% for the removal of  $\text{PO}_4\text{-P}$  and total suspended solids, and 77% for  $\text{TN}$  removal), calculated with the Weibull method, confirmed that the treatment plant could be used as an effective tool for protecting the quality of local water resources (especially in ecologically valuable mountainous areas) regardless of changeable weather conditions and variable loads of pollutants characteristic of individual wastewater management in rural regions.

The statistical methods based on the Weibull as well as the lognormal data distributions describe very well the degree of stability and technological reliability of treatment processes, and the differences between them in estimating reliability are negligible.

The Weibull method is especially well-suited for comparing the specific functional features of various types of rural domestic WWTPs, but the log-normal distribution can also be used.

## REFERENCES

- Bugajski, P. 2014 Analysis of reliability of the treatment plant Bioblok PS-50 using the method of Weibull. *Infr. Ecol. of Rur. Are* **II/3**, 667–677 (in Polish).
- Bugajski, P., Wałęga, A. & Kaczor, G. 2012 Application of the Weibull reliability analysis of household sewage treatment plant. *Gaz, Woda i Technika Sanitarna* **2**, 56–58 (in Polish).
- Djeddou, M. & Achour, B. 2015 Wastewater treatment plant reliability prediction using artificial neural networks. In: *12th IWA Specialised Conference on Design, Operation and Economics of Large Wastewater Treatment Plants*, 6–9 September 2015, Prague, Czech Republic.
- Eisenberg, D., Soller, J., Sakaji, R. & Olivieri, A. 2001 A methodology to evaluate water and wastewater treatment plant reliability. *Water Sci. Technol.* **43** (10), 91–99.
- Gajewska, M., Jóźwiakowski, K., Ghrabi, A. & Masi, F. 2015 Impact of influent wastewater quality on nitrogen removal rates in multistage treatment wetlands. *Environ. Sci. Pollut. Res.* **22**, 12840–12844.
- Gizińska-Górna, M., Czekala, W., Jóźwiakowski, K., Lewicki, A., Dach, J., Marzec, M., Pytka, A., Janczak, D., Kowalczyk-Juško, A. & Listosz, A. 2016 The possibility of using plants from hybrid constructed wetland wastewater treatment plants for energy purposes. *Ecol. Eng.* **95**, 534–541.
- HELCOM Recommendation 28E/6 2007 Adopted 15 November 2007 having regard to article 20, Paragraph 1 b) of the Helsinki Convention. *On-site wastewater treatment of single family homes, small businesses and settlements up to 300 Person Equivalents (P.E.)*.
- Jucherski, A. 2007 The quality of farm house-hold wastewater treatment in quasi-technical farmstead installation of IBMER model, in winter period on the mountainous terrain. *Probl. Inż. Rol.* **2** (56), 51–60 (in Polish).
- Jucherski, A. & Walczowski, A. 2012 Quasi-technical sewage treatment plants in protection of the water resources on rural mountain terrains. *Probl. Inż. Rol.* **3** (77), 151–158 (in Polish).
- Jóźwiakowski, K., Marzec, M., Gizińska-Górna, M., Pytka, A., Skwarzyńska, A., Gajewska, M., Słowik, T., Kowalczyk-Juško, A., Steszuk, A., Grabowski, T. & Szawara, Z. 2014 The concept of construction of hybrid constructed wetland for wastewater treatment in Roztoczański National Park. *Barometr Regionalny* **12** (4), 91–102.
- Jóźwiakowski, K., Mucha, Z., Generowicz, A., Baran, S., Bielińska, J. & Wójcik, W. 2015 The use of multi-criteria analysis for selection of technology for a household WWTP compatible with sustainable development. *Arch. Environ. Prot.* **3**, 76–82.
- Jóźwiakowski, K., Gajewska, M., Marzec, M., Gizińska-Górna, M., Pytka, A., Kowalczyk-Juško, A., Sosnowska, B., Baran, S., Malik, A. & Kufel, R. 2016 Hybrid constructed wetlands for the National Parks – a case study, requirements, dimensioning, preliminary results. In: *Natural and Constructed Wetlands. Nutrients, Heavy Metals and Energy Cycling, and Flow* (J. Vymazal, ed.). Springer International Publishing, Switzerland, pp. 247–265.
- Masi, F., Martinuzzi, N., Bresciani, R., Giovannelli, L. & Conte, G. 2007 Tolerance to hydraulic and organic load fluctuations in constructed wetlands. *Water Sci. Technol.* **56** (3), 39–48.
- Masi, F., Caffaz, S. & Ghrabi, A. 2013 Multi-stage constructed wetlands systems for municipal wastewater treatment. *Water Sci. Technol.* **67**, 1590–1598.
- Massoud, M. A., Tarhini, A. & Nasr, J. A. 2009 Decentralized approaches to wastewater treatment and management: applicability in developing countries. *J. Environ. Manage.* **90** (1), 652–659.

- Nastawny, M. & Jucherski, A. 2013 Assessing technical reliability of an on-site sewage treatment plant with filtration bed system, by using modified Weibull's method. *Probl. Inż. Rol.* **2** (80), 165–175 (in Polish).
- Niku, S., Schroeder, E. D. & Haugh, R. S. 1982 Reliability and stability of trickling filter processes. *J. Water Pollut. Control. Fed.* **54** (2), 129–134.
- Oliveira, S. C. & Sterling, M. V. 2008 Reliability analysis of wastewater treatment plants. *Water Res.* **42**, 1182–1194.
- Osaliya, R., Kansime, F., Oryem-Origa, H. & Kateyo, E. 2011 The potential use of storm water and effluent from a constructed wetland for re-vegetating a degraded pyrite trail in Queen Elizabeth National Park, Uganda. *Physics and Chemistry of the Earth, Parts A/B/C* **36** (14–15), 842–852.
- Platzer, C. & Mauch, K. 1997 Soil clogging in vertical flow reed beds – mechanisms, parameters, consequences and ..... solutions? *Water Sci. Technol.* **35** (5), 175–181.
- Regulation of the Minister of Environment 2014 On the conditions to be met when sewage into water or soil and on substances particularly harmful to the aquatic environment, Dz. U. nr 239 poz. 1800 (in Polish).
- Sanchez-Ramos, D., Sánchez-Emeterio, G. & Beltrán, M. F. 2015 Changes in water quality of treated sewage effluents by their receiving environments in Tablas de Daimiel National Park, Spain. *Environ. Sci. Pollut. Res.* **23** (7), 6082–6090.
- Wałęga, A. 2009 Assessment of the wastewater treatment plants statistical methods. *Forum eksploatacja* **5** (44), 30–34 (in Polish).
- Wałęga, A., Miernik, W. & Kozień, T. 2008 The efficiency of a domestic sewage treatment plant type RetroFAST. *Przemysł Chemiczny* **87** (5), 210–212 (in Polish).
- Wojciechowska, E., Gajewska, M. & Ostojski, A. 2016 Reliability of nitrogen removal processes in multistage treatment wetlands receiving high-strength wastewater. *Ecol. Eng.* **98**, 365–371.

First received 11 November 2016; accepted in revised form 21 February 2017. Available online 9 March 2017