

The leakage of sewer systems and the impact on the 'black and odorous water bodies' and WWTPs in China

Y. S. Cao, J. G. Tang, M. Henze, X. P. Yang, Y. P. Gan, J. Li, H. Kroiss, M. C. M. van Loosdrecht, Y. Zhang and G. T. Daigger

ABSTRACT

China has achieved significant progress on wastewater treatment and aquatic environmental protection. However, leakage (in- and exfiltration) of sewer systems is still an issue. By using the statistical data of water and wastewater in 2016 in China, and the person loads (PLs) of water and wastewater in Singapore, the leakage fractions of hydraulic flow, organic carbon (COD), nitrogen (N) and phosphorus (P) mass loading, and in-sewer COD biological removal in the sewer systems of China (except Hong Kong, Macau and Taiwan), Shanghai, Guangzhou and Beijing were reported for the first time. The fractions of hydraulic flow infiltration (13%, Shanghai and Guangzhou) and exfiltration (39%, China) were calculated. Except Beijing, whose sewer networks are under appropriate management with small leakage fractions, the exfiltration fractions of COD (including in-sewer biological COD removal) ranged from 41% (Shanghai) to 66% (China) and averaged 55%; N ranged from 18% (Shanghai) to 48% (China) and averaged 33%; and P ranged from 23% (Shanghai and Guangzhou) to 44% (China) and averaged 30%. The exfiltrated sewage, COD, N and P not only wastes resources, but also contaminates the aquatic environment (especially groundwater) and contributes to 'black and odorous water bodies'. In- and exfiltration in the sewer network leads to low influent COD concentration, C/N ratio and high inorganic solids and inert particulate COD concentrations of many municipal wastewater treatment plants (WWTPs) causing high cost for nutrient removal, poor resource recovery, additional reactor/settler volume requirement and other operational problems. Therefore, tackling sewer leakage is of primary importance to today's environment in China. Recommendations for the inspection of sewer systems and the rehabilitation of damaged sewers as well as the development of design and operation guidelines of municipal WWTPs tailored to the specific local sewage characteristics and other conditions are proposed.

Key words | black and odorous water bodies, exfiltration, infiltration, municipal wastewater treatment, nutrient removal, sewer

Y. S. Cao (corresponding author)

41 Tian Jia Xian,
Blk 6, 215006 Suzhou,
China
E-mail: cao_yeshi1949@hotmail.com

J. G. Tang

Shanghai Urban Construction,
Design and Research Institute,
No. 3447 Dong Fang Rd., 200125 Shanghai,
China

M. Henze

Department of Environ. Eng.,
Technical University of Denmark,
Bldg 115 DK-2860, Lyngby,
Denmark

X. P. Yang

Y. P. Gan

China Water and Wastewater Treatment
Association,
No. 5 East road Lian Huwa Est Rd, B Tower Time
Square 2310, Beijing,
China

J. Li

School of Environ. and Civil Eng.,
Jia Nang University,
No. 1800 Li Avenue, Pin Hou District, Wuxi,
China

H. Kroiss

Institute of Water Quality and Resource
Management,
Vienna University of Technology,
Vienna 1040,
Austria

M. C. M. van Loosdrecht

Department of Biotechnology,
Delft University of Technology,
Van der Maasweg 9, 2629 HZ Delft,
The Netherlands

Y. Zhang

China Water Industry Association,
No. 9, San Li He, 100835 Beijing,
China

G. T. Daigger

Department of Civil and Environ. Eng.,
University of Michigan,
1351 Beal Avenue, Ann Arbor, MI 48109,
USA

INTRODUCTION

China has achieved significant progress on water pollution control: the total wastewater treatment capacity reached 1,760 million m³/day in 2016 (CUWA 2017a), the largest in the world (CUWA 2017a). However, 'black and odorous water bodies' are still a challenge. The discharge standards for nitrogen and phosphorus have been tightened and implemented nation wide (Zheng 2017). But many municipal wastewater treatment plants (WWTPs) are confronting a series of issues including a needed response to these new discharge regulations.

The influent organic carbon (chemical oxygen demand, COD) concentration is often abnormally low (Table 1) (MHUR 2017). The average influent COD of municipal WWTPs in China in 2016 was 267 mg COD/L only (CUWA 2017a), much lower than 400 up to 1,000 mg COD/L in Central Europe, and 400 mg/L on average for whole Europe (Dohmann 2017). Among 30 provinces and internal autonomy regions in China there were eight with influent COD <200 mg/L on average, and fifteen <250 mg COD/L (Tang 2017). The influent COD of WWTPs with a capacity ≥100,000 m³/d in Guangzhou averaged 181 mg COD/L only (Table 1) (MHUR 2017). The influent COD of some WWTPs in Southern China is even lower than 100 mg COD/L (CUWA 2017a). The reported influent C/N ratio (7.5–8.8) (Table 5) is between the low and typical range (Henze *et al.* 2002), with high inert particulate COD and low XCOD/SS (defined below) ratio (Dai 2017; Yang 2017; Zheng 2017; Wu 2018). To direct more carbon for nutrient removal, primary settling tanks (PSTs) were omitted in many municipal WWTPs and only a few anaerobic digesters for energy recovery are in use (< 10% of treatment plants) (Dai 2017) in China. Even so, the addition of carbon is still widely practiced in many WWTPs in China in order to meet nutrient discharge standard (e.g. TN <10 mg/L, first grade A class discharge standards) (Zheng 2017). These

factors all lead to the unsustainable management and operation of many municipal WWTPs.

The low influent COD concentration of municipal WWTPs indicates leakage (in- and exfiltration) of sewage to/from the sewer systems. Leakage herewith includes in- and out-flow through manholes or broken pipes and water seeping in and out of sewers depending on the relative difference between sewage level in the sewer and the ground/river water level. Infiltration (from external to inside sewer system) happens when the ground/river water level is higher than that in sewer. Exfiltration (from inside sewer to external) happens when ground/river water level is lower than that in sewer. Also, a very high drinking water consumption caused by failures of household water infrastructure (valves do not stop water flow any more, etc.) or water loss from the water supply network can contribute to low influent concentrations. Adequate modern household infrastructure in Europe results in a water consumption of 100 to 150 L/cap.day. Differing from nitrogen (N) and phosphorus (P) in sewage, biological COD removal occurs in sewer systems through aerobic heterotrophic conversion in gravity flow sewers and anaerobic metabolisms within thick biofilms attached on the wall or the benthic sediment in gravity flow sewer and pressure mains. Leakage of sewer systems is a worldwide issue even in developed countries such as in Denmark, Germany (Eiswirth & Hotzl 2004; Dohmann 2017), UK (Ellis 2001) and The Netherlands. Nowadays, much effort has been invested in China to improve aquatic environment quality, typically to eliminate 'black and odorous water bodies', and it was recognized that the issue is related to leakage from the sewer network (Tang 2017; Yang 2017; Zhang 2017). Similarly, the interrelated relationships between 'black and odorous water bodies' and WWTP performance was recognized as saying 'black and odorous water bodies' will not disappear unless 'influent concentrations of WWTPs are increased' (Tang 2017).

The quantification of leakage fractions of sewer network is an essential starting point for development of cost-effective approaches and rational strategies to solve the issue of leakage of sewer systems. However, this type of quantification is still limited. The objectives of this study were threefold: (i) to develop a simple approach to quantify the fractions of sewer leakage including hydraulic flow, C, N and P mass loading and biological COD in-sewer removal; (ii) to discuss the impact of sewer leakage on the 'black and odorous water bodies' and performance and

Table 1 | Characteristics of the influent of municipal WWTPs in China* and Singapore** (in mg/L)

| | COD | BOD ₅ | TSS | TN | NH ₄ -N | TP |
|-----------|-----|------------------|-----|----|--------------------|-----|
| China | 267 | 111 | 182 | 34 | 25 | 3.8 |
| Shanghai | 280 | 138 | 158 | 32 | 24 | 4.1 |
| Guangzhou | 181 | 92 | 186 | 24 | 19 | 3.5 |
| Beijing | 513 | 225 | 289 | 56 | 38 | 6.7 |
| Singapore | 565 | 325 | 296 | 50 | 38 | 6.5 |

*CUWA (2017b), **Cao *et al.* (2014).

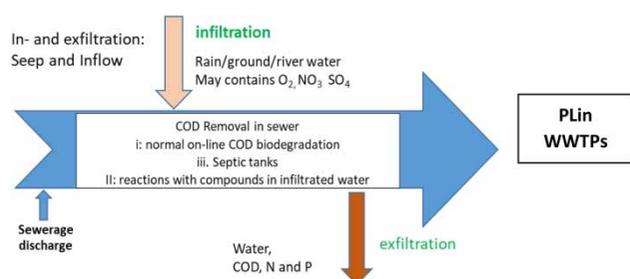


Figure 1 | Conceptualization of sewer in- and exfiltration.

operation of municipal WWTPs in China; and (iii) to make recommendations according to the outcome of the study.

METHODOLOGY AND APPROACHES

Figure 1 presents the concepts of leakage to/from the sewer and the mass balances based on calculations of fractions of sewer leakage. The N and P concentrations of the municipal WWTP influent are governed by: (i) person loads (PLs) (Henze & Comeau 2008) of (domestic) water consumption (L/cap.day), personal nitrogen and phosphorus discharge (g/cap.day), (ii) in- and exfiltration to/from sewer systems, assuming little reactions involving N and P (as conservative compounds), and only P-free detergents are available; (iii) little discharge of industry wastewater into sewers. For the COD concentration, biological in-sewer removal is another factor, in addition to the three factors mentioned above (Henze *et al.* 2002). Given 75% of the population in Singapore are Chinese, and the excellent construction quality and management practices of sewer systems in Singapore, the PLsr express personal (domestic) water consumption (PLrw), and discharged COD (PLrc), N (PLrn) and P (PLrp) in Singapore as reference in this study. The PLins express personal wastewater treated (PLinw), (L/cap.day), discharged COD (PLinc), N (PLinn) and P

(PLinp) (g/cap.day) measured at the WWTP influent (Figure 1). The PLinw of 0.196 m³/cap.day in Singapore was calculated based on the total 1.5 million cubic meter wastewater/day minus 400,000 cubic meter industries wastewater/day and 5.61 million population (DSS 2017) in Singapore. Given the separate sewer systems, 10% of hydraulic infiltration fraction during dry weather (DW), and negligible exfiltration assumed in Singapore, the PL (of domestic) water consumption (PLrw) in Singapore was 0.176 m³/cap.day (Table 2). With the COD, N and P concentrations (Cs) of the municipal WWTPs influent (Table 1) (Cao *et al.* 2014) and assuming 10% biological COD in-sewer removal and negligible exfiltration of COD, N and P, the PLrs, which were calculated by the equation of (PLrw x Cs) in Singapore, are: 121.0 g COD/cap.day (110 × 1.1) (PLrc), 9.7 g N/cap.day (PLrn) and 1.0 g P/cap.day (PLrp). These PLsr values are almost the same as in Austria and Germany (Kroiss 2015).

The leakage fractions of hydraulic flow, COD, N and P mass in the sewer systems of China (except Hong Kong, Macau and Taiwan), Shanghai, Guangzhou, and Beijing are evaluated in this paper. Considering the different development levels in different regions in China, 70% of the PLs in Singapore was adopted as reference for China in this study, while 100% of the PLs in Singapore were used in calculations for Shanghai, Guangzhou, and Beijing. The personal (domestic) water consumption in China and three cities (Table 2) (PLw), were calculated from total water production minus water supplied to industry per capita, taken from CUWA (2017b), and the personal wastewater (PLinw) were taken from CUWA (2017a) (Table 2). The differences between the PLw and PLinw of the four cases show the (net) leakage, i.e. exfiltration, when the difference was positive and infiltration, when the difference was negative (Table 2). The influent concentrations (Cin) of WWTPs in China and three cities (Table 1) were the inflow hydraulic flow weighted averages of municipal WWTPs with the

Table 2 | The person loads of water consumption, treated and fractions of hydraulic leakage and COD exfiltration

| | PL of water consumption (PLW)* m ³ /cap.d | PLin of water treated (PLinw)** m ³ /cap.d | Per. PL of water in- or ex- filtrated %*** | PLin of COD in inf. WWTPs (PLinc) g COD /cap.d | PL of COD disappeared g COD/cap.d | Fraction of COD exfiltration, %**** |
|------------------------|--|---|--|--|-----------------------------------|-------------------------------------|
| China | 0.168 | 0.103 | +39 | 28 | 56 | 66 |
| Shanghai | 0.223 | 0.252 | -13 | 71 | 50 | 41 |
| Guangzhou | 0.246 | 0.277 | -13 | 50 | 71 | 59 |
| Beijing | NA | 0.194 | NA | 100 | 21 | 17 |
| Singapore [#] | 0.176 | 0.196 | -10 | 110 | 11 | 10 |

*CUWA (2017b), **CUWA (2017a), ***Calculated by (PLw-PLinw)/PLw, ****Calculated by (PLrc-PLinc)/PLrc, [#]Cao *et al.* (2014).

Table 3 | The nitrogen Person Load at the WWTP influent (PL_{inn}) and the fractions of exfiltration

| | PL _{in} of N in inf. WWTPs (PL _{inn}), g N/cap | PL of N disappeared g N /cap.d | Fraction of N exfiltration, % * |
|-----------|---|--------------------------------|---------------------------------|
| China | 3.5 | 3.3 | 48 |
| Shanghai | 8.0 | 1.7 | 18 |
| Guangzhou | 6.6 | 3.1 | 32 |
| Beijing | 10 | (+ 0.03) | NA |
| Singapore | 9.8 | 0.2 | 0 |

*Calculated by (PL_{rn} - PL_{inn})/PL_{rn}.

treatment capacity $\geq 100,000$ m³/day (MHUR 2017). The PL_{ins} were the personal loads and calculated by the equation of (PL_{inw} × C_{in}) of COD (PL_{inc}, Table 2), N (PL_{inn}, Table 3) and P (PL_{inp}, Table 4) delivered to the WWTPs for the four cases. The differences between PL_{rs} of COD, N and P in Singapore and respective PL_{ins} (PL_{sr} - PL_{ins}) of the four cases indicate the magnitude of leakage of COD, N and P mass flow, respectively. The fractions of leakage were calculated by the equation of (PL_{rc} - PL_{inc})/PL_{rc} for COD (Table 2), (PL_{rn} - PL_{inn})/PL_{rn} for N (Table 3) and (PL_{rp} - PL_{inp})/PL_{rp} for P (Table 4) mass flow, respectively. As shown in the following sessions, the exfiltration fractions of COD were always higher than those of N and P. By assuming the same COD fraction of leakage as N and P, the differences of COD fraction minus those of N or P (the exfiltration fraction of COD - the exfiltration fraction of N or P) was regarded as the fraction of COD in-sewer removal through biological conversions. Depending on local conditions, the actual fraction of COD biological in-sewer removal could be higher than those calculated especially for sewer systems with high slope and high flow velocities as well in the case of nitrate rich groundwater infiltration. Thus, the fraction calculated in this study could be regarded as the minimum percentage. Given that

Table 4 | The phosphorus Person Loads at the WWTPs influent (PL_{inp}) and the fractions of exfiltration

| | PL _{in} of P in inf. WWTPs (PL _{inp}), g P /cap.d | PL of P disappeared g P /cap.d | Fraction of P exfiltration, %* |
|-----------|--|--------------------------------|--------------------------------|
| China | 0.4 | 0.4 | 44 |
| Shanghai | 1.0 | 0.3 | 23 |
| Guangzhou | 1.0 | 0.3 | 23 |
| Beijing | 1.3 | NA | 0 |
| Singapore | 1.3 | 0.2 | 0 |

*Calculated by (PL_{rp} - PL_{inp})/PL_{rp}.

the data used were annual average-based, the fractions calculated in this study are 'net' values, and the different situations likely observed under dry and weather conditions were not assessed.

RESULTS

Leakage fractions of the four cases

Case I China

The average influent COD of 267 mg COD/L for municipal WWTPs in China 2016 (CUWA 2017a) ranged between diluted and very diluted (Henze *et al.* 2002). As introduced in Methodology and approaches, given the difference between the personal water consumption and personal water treated (Table 2), 39% of hydraulic flow (sewage) exfiltrated from the sewer system. Considering the results for major cities in Southern China presented below, hydraulic exfiltration may be occurring in Northern China, where the groundwater level is lower in general, compared to net infiltration in Southern China, where the groundwater level is higher in general. Infiltration in southern China may contribute to the low COD, N and P concentrations (Table 1) due to dilution. In contrast, for Northern China, given the difference between the PL of COD 85 g COD/cap.day (121 × 70%) (reference, PL_{rc}) and PL_{in} of 28 g COD/cap.day (PL_{rc}) (Table 2), 66% of the COD in municipal sewage discharged exfiltrated out of the sewer systems including consumed by biological in-sewer reaction (Table 3). Using the similar approaches as for COD, 48% of N (Table 3) and 44% of P (Table 4) exfiltrated from sewer systems. Compared to that of COD, the smaller fractions of N and P ex-filtration point to the biological COD in-sewer removal. Taking 46% as the average fraction of direct exfiltration then, at least 20% COD (66%–46%) was removed through biological in-sewer conversions (Figure 2).

Case II Shanghai

The flow weighted average influent COD concentration in Shanghai, which were calculated from the 11 municipal WWTPs with capacity $\geq 100,000$ m³/day (MHUR 2017), was 280 mg COD/L (Table 1). It ranged between diluted and very diluted according to Henze *et al.* (2002). Differing from hydraulic exfiltration in China, 13.4% (net) of hydraulic infiltration occurred according to the PL_w of water consumption and PL_{inw} of water treated (Table 2). This

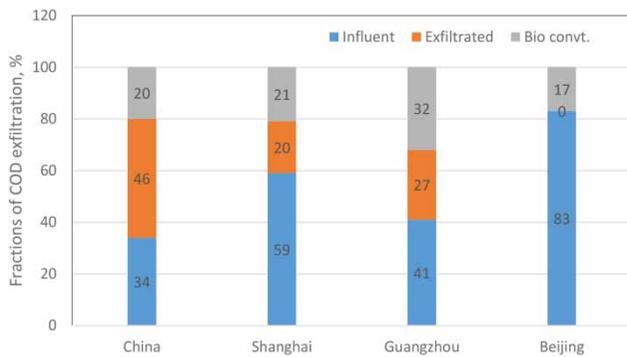


Figure 2 | COD fate in the sewer systems of China, Shanghai, Guangzhou, and Beijing.

may be attributed to the high groundwater level in the Yangtze delta. The high level operation of the sewer networks, illegal connection with rain water system (Tang 2017; Zhang 2017), fluctuation of groundwater levels (Eiswirth & Hotzl 2004), etc., might be relevant factors to the moderate fractions. 41% of COD (Table 2), 18% of N (Table 3) and 23% of P (Table 4) are on average lost from the sewer system. Taking 20% as the average direct exfiltration fraction, the fraction of biological COD in-sewer conversion was estimated as 21% COD (Figure 2).

Case III Guangzhou

The hydraulic flow weighted average influent COD concentration of 181 mg COD/L (Table 1) was calculated from the 19 municipal sewage WWTPs with capacity $\geq 100,000 \text{ m}^3/\text{day}$ in Guangzhou (MHUR 2017). The concentrations were generally very diluted (Henze *et al.* 2002). Of the influencing factors, high water consumption (269 L/cap.day) was a contributor. The fraction of hydraulic infiltration was 13% (Table 2). The fractions of COD, N and P exfiltration were 59% (Table 2), 32% (Table 3) and 23% (Table 4), respectively. Assuming 27% as the direct exfiltration fraction, 32% of COD was removed through biological in-sewer conversion (Figure 2), which is higher than China and Shanghai.

Case IV Beijing

The average influent concentration for COD was 513 mg/L (Table 1), which was calculated from the eleven municipal WWTPs with capacity $\geq 100,000 \text{ m}^3/\text{day}$ in Beijing (MHUR 2017). It was much higher than China average, Shanghai and Guangzhou. The hydraulic in- and exfiltration fraction could not be calculated because of a lack of personal water consumption data, although the groundwater level is deeper for sewer systems in Beijing (Gan 2017). However, only 17%

of COD (Table 2) was estimated to be removed through biological in-sewer conversion (Figure 2), and little N and P were ex-filtrated (Tables 3 and 4), demonstrating an excellent condition of the sewer systems in Beijing.

High inert solid component and low BOD₅/N ratio

Data reported by others can be used to assess the inert solids fractions for Chinese sewage. The fraction of inert particulate COD (Xi) measured for the influent of WWTPs in Shanghai could be above 30% (Zhou *et al.* 2008), and even higher values were measured in other cities' sewage (Wu 2018), compared to between 8% and 20% for typical municipal sewage (Henze 1992). The particulate XBOD₅/SS ratio of the influent in many WWTPs in China ranged between 0.3 and 0.5 (Dai 2017), which is much lower than the range between 0.8 and 1.0 for typical sewage (Henze *et al.* 2002). Similarly, the XCOD/SS ratio of the influent measured in some WWTPs in China was often <1.0 (Wu 2018; Yang 2018), which was below the typical range between 1.2 and 2.0 (Henze *et al.* 2002) (1.4 in Singapore, Cao *et al.* 2014). The volatile suspended solids/suspended solids (VSS/SS) ratio of the influent in dozens of municipal WWTPs varied between 30% and 60% (Dai 2017; Ji 2017; Zheng 2017; Wu 2018), which was much lower than the 70% for typical municipal sewage (Henze *et al.* 2002). All these data demonstrate the high inert particulate COD (Xi) and inorganic solids in the sewage in many locations in China.

The BOD₅/N ratios of the municipal sewage in China and three cities ranged between 3.3 (China) and 4.4 (Shanghai) (Table 5) and averaged 3.9, which is at the low range (3–4) (Henze *et al.* 2002). The influent COD/N ratio of four cases ranged between 7.5 (Guangzhou) and 8.8 (Beijing) (Table 5) and averaged 8.0, which is the upper value of the low range (6–8) (Henze *et al.* 2002) (Table 5). Both ratios were much lower than in Singapore (Table 5). These abnormal ratios for the sewage in many WWTP influents are closely related to leakage of the sewer works, as discussed in following sections.

Table 5 | The ratios of organic carbon and nitrogen of the sewages of China, three cities* and Singapore**

| Ratio | China | Shanghai | Guangzhou | Beijing | Singapore |
|----------------------|-------|----------|-----------|---------|-----------|
| COD/BOD ₅ | 2.4 | 2.0 | 2.0 | 2.3 | 1.8 |
| COD/TN | 7.7 | 8.7 | 7.5 | 8.8 | 11.3 |
| BOD ₅ /TN | 3.3 | 4.4 | 3.8 | 4.0 | 7.6 |
| N/P | 8.9 | 7.8 | 6.8 | 8.5 | 7.7 |

*CAWU (2017b), **Cao *et al.* (2014).

DISCUSSION

Sewer leakage and interactions with the aquatic environment

The leakage of sewer works in China is startling: approximately 40% of sewage and half of COD, N and P in the sewers are exfiltrated out the sewer system without any treatment. This means that only approximately half of municipal sewage reaches the treatment plants and to be treated, at the same time another 50% of sewage is discharged into the aquatic environment. The fractions of COD, N and P ex-filtrated from the sewers in Shanghai and Guangzhou are approximately 30%. However, the fractions of exfiltration in these two cities could be higher than 30% if all the WWTPs with capacity less than 100,000 m³/day in these two cities are included in the calculations. The COD, N and P ex-filtrated from sewer systems recharge groundwater or surface water and contribute to 'black and odorous water bodies'. Notably, exfiltration of these compounds results in diffuse pollution, which is difficult to control (Metcalf & Eddy 2003). The ex-filtrated sulphate and nitrogen compounds contained in the sewage can be either reduced (sulphate to sulfite) or oxidized (ammonia to nitrate/nitrite,) depending on environmental conditions. These reduced or oxidized compounds then can infiltrate again into the damaged sewer systems to react with oxygen or organics of sewage (Eiswirth & Hotzl 2004; Huisman *et al.* 2004). Also, infiltrated ground or river water may bring reactive compounds such as nitrate (NO₃), sulfate (SO₄) and dissolved oxygen, etc., into the sewer (Eiswirth & Hotzl 2004), allowing biological in-sewer reactions that consume organic compounds, resulting in consumption of biodegradable COD.

The average N/P ratio of influents to WWTPs in China, Shanghai, Guangzhou and Beijing was approximately 8.0, which is close to 7.7 in Singapore (Table 5). The observation that N/P ratios are in a similar range supports the assumption of N and P as conservative compounds in sewer processes. Given the average 55% of COD exfiltration, and the 22% of N and P exfiltrated, the fraction of COD in-sewer removal was at least 23%. Biological COD in sewer removal could be through aerobic heterotrophic conversion or anaerobic metabolisms (Sollfrank & Gujer 1991; Henze 1992), and/or reduction by denitrification of nitrate (Abdul-Talib *et al.* 2002), which could be the same percentage (~20%) as aerobic heterotrophic conversion (Nielsen *et al.* 1992; Huisman *et al.* 2004). For the latter, high nitrate concentrations in the contaminated groundwater nationwide distributed in China was reported (Gu *et al.* 2013; Han

et al. 2016), although few studies on nitrate reaction with COD in sewer systems have been published.

Rationally designed and operated sewer systems are essential to protect the aquatic environment, eliminate 'black and odorous water bodies' and allow the efficient and sustainable operation of municipal WWTPs. The Beijing case demonstrates the effectiveness of the management strategy of 'intergrading the plants and sewer system at a whole' (Yang 2017), where all large municipal WWTPs remove nutrients and operate anaerobic digesters to produce biogas for energy recovery. With the recently promulgated technology guideline for sewer rehabilitation (MHUR 2016), which should result in a rational and workable plan for the implementation of a sewer rehabilitation strategy, the sewer system can be improved and operated at high efficiency in China.

Impact on the performance and operation of WWTPs

Hydraulic infiltration (Shanghai and Guangzhou) and exfiltration (China) can result in the operation of the hydraulic flow-based treatment system units (such as screen, grit removal, pumps and pipes, etc.) to deviate from their design capacity. The high exfiltration fractions of COD, N and P result in the biological units operating under low mass loading conditions. The low ratios of influent XCOD/SS and VSS/TSS are related to infiltrated fine sand and clay with a diameter <200 µm derived from land development and urbanization (Ji 2017). The high fractions of COD exfiltration and biological in sewer removal directly cause the lower C/N (and BOD/N) ratio of municipal sewage and addition of external carbon for nutrient removal in many WWTPs in China. Furthermore, given the abnormal high fraction of inert (Xi) and low XCOD/SS ratio, the efficiencies of denitrification and biological phosphorus removal in the context of WWTPs in many WWTPs in China could be reduced, compared to those of typical sewage under the similar influent COD/N ratio (Puig *et al.* 2010). Calculations show, corresponding to the average influent COD of 340 mg/L for the four cases (Table 1), a reduction of 15% of the COD exfiltration could increase approximately 50 mg biodegradable COD/L in the influent, which would enable an extra approximately 10 mg NO₃-N/L to be denitrified.

The fine inorganic solids escape grit removal and accumulate in activated sludge tanks, thereby reducing the VSS/MLSS ratio of the mixed liquor to the range between 30% and 50% in many WWTPs (Zheng 2017; Ji 2017; Li 2018) compared to the normal range between 70% and 80% (Henze *et al.* 2002). The reduced VSS/TSS ratio requires

extra volume (space) of activated sludge tank and anaerobic digesters (Daigger 2014). Furthermore, the inert solids that settle in the reactor can reduce effective reactor volume (Ji 2017). The result can be an inability for effluent quality to meet the discharge requirements (Zheng 2017). The high inert inorganic and COD content of the sludge fed to anaerobic digesters (Ji 2017) leads to lower biogas yield, corresponding to low removal efficiency of solids (Dai 2017).

The high inorganic solid content of sludges (primary and waste activated) not only decrease biogas production in digestion, and also heat value content of dewatering sludge, making auto-thermal incineration operation difficult (Ji 2017). Erosion of mechanical equipment, e.g. pumps, pipes, and blowers, etc., due to fine sand and clay were observed (Ji 2017). Together with the impacts discussed above, all of these items reduce the efficiency and sustainable WWTP operation, demonstrating the deteriorated impact of sewer leakage on the performance and operation of individual units and the WWTPs as a whole. On the other hand, current practices of removal of primary settling tanks and anaerobic sludge digesters could be over-simplified. Much careful considerations and evaluations to tailor the facility and process to the specific local sewage characteristics may be needed in order to achieve optimal design and upgrading of municipal WWTPs. In response to the unique sewage characteristics in China, a rational, integrated design guideline for individual units/processes, and whole WWTP process, in China is necessary and should be developed (Cao & Daigger 2018).

SUMMARY AND RECOMMENDATIONS

The leakage of sewers in Case China is startling: approximately 40% of sewage and half of COD, N and P in the sewers are exfiltrated or removed in the sewer system without any treatment, which illustrates that only approximately half of municipal sewage reaches the treatment plants to be treated. The substantial exfiltration of sewage and chemicals without treatment impairs the aquatic environment, contributes to 'black and odorous water bodies', and wastes water, energy and nutrients.

The high fractions of COD exfiltration and biological in-sewer removal are resulting in the low COD concentration and C/N ratio and biodegradable COD components of WWTP influents. As a consequence, a series of problems occurs, such as extra bioreactor volumes required, high cost of nutrient removal, low biogas yield and sludge mineralization rate, poor energy recovery, and mechanic erosion.

Combined with the negative impact on the aquatic environment, restoration of the integrity of sewer systems to eliminate in- and exfiltration would be a pressing challenge to close the urban water cycle and achieve integrated and sustainable resource management.

Recommendations for further actions are provided as follows.

To enhance the investigations on the leakage (in- and exfiltration) of current sewer systems:

- Carry out a national survey on in- and exfiltration in the current sewer network aimed at rational estimation and calculation of the fractions of in- and exfiltration of hydraulic flow, COD, N and P, and biological COD in-sewer removal at the levels of municipalities and the corresponding WWTPs. To obtain quantitative results, investigations should include those under dry/wet-weather and temporal/spatial conditions (e.g. ground-water level changes during the year) to facilitate exploration of the complex mechanisms behind the phenomena.
- Investigate the influences of in- and exfiltration on the aquatic environment, especially 'black and odorous water bodies', in the context of the local conditions.
- Investigate the interactions between infiltrated ground-water/river water and sewage and between exfiltrated sewage and ground/river water, and the effects of these interrelations on the aquatic environment and biological COD in-sewer removal.
- Establish a tasks list and alternatives, priorities them and then formulate a plan of rehabilitation and management of damaged sewers, according to a cost-effective analysis.

To enhance studies on the performance and operation of municipal WWTPs under current sewage characteristics:

- Evaluate sewage characteristics, especially the fractions of biodegradable and inert particulates, under local conditions, since knowledge of these characteristics is an indispensable step for the reliable design and operation of wastewater treatment processes and WWTP as a whole.
- Assess the efficiency of individual units/processes, typically grit removal installations and biological units, under current influent characteristics and benchmark with those under typical influent conditions with normal exfiltration and infiltration. Then identify the bottlenecks for improvement or upgrading accordingly.
- Develop rational, integrated design guidelines for individual units/processes for the WWTP as a whole under the

current sewage characteristic conditions, especially for areas where in- and exfiltration of sewer works is serious.

REFERENCES

- Abdul-Talib, S., Hvitved-Jacobsen, T., Vollertsen, J. & Ujang, Z. 2002 *Anoxic transformations of wastewater organic matter in sewers – process kinetics, model concept and wastewater treatment potential*. *Water Science & Technology* **45** (3), 53–60.
- Cao, Y. S., Kwok, B. H., Noraini, A. Z., Lau, C. L., Zulkifli, I., Chua, S. C., Wah, Y. L. & Yahya, A. G. 2014 The Mainstream Partial Nitritation-Anammox Nitrogen Removal in the Largest Activated Sludge Process and Comparisons with Other BNR Activated Sludge Process in Singapore. In: *IWA World Water Congress*, 21–26 September 2014, Lisbon, Portugal.
- Cao, Y. & Daigger, G. 2018 Key influences of sewage characteristics to the design and upgrading of WWTPs: from empirical to mechanistic. In: *2nd National Workshop on WWTPs Upgrading to Meet new Discharge Standard*, 3–5 September 2018, HuFai.
- CUWA 2017a *Wastewater Statistic Annual Book 2017*.
- CUWA 2017b *Water Supply Statistic Annual Book 2017*.
- Dai, S. H. 2017 Bottleneck and technology analysis of sludge treatment and disposal. In: *The 8th National Workshop of Municipal Sludge Treatment and Disposal*, 25 May 2017, Beijing, China.
- Daigger, G. T. 2014 *Ardern and Lockett Remembrance IWA Conference: Activated Sludge – 100 Years and Counting*, Essen, Germany, 12 June.
- Dohmann, M. 2017 Control and treatment of black and odorous waterbodies: control of rainwater and pollution overflow. In: *Workshop of Control and Treatment of Black and Odorous Waterbodies*, 4–5 May 2017, Shanghai, China.
- DSS 2017 Latest Data. <http://www.singstat.gov.sg/statistics/latest-data#16>.
- Eiswirth, M. & Hötzl, H. 2004 *Impact of Leaking Sewers on Urban Groundwater* (J. Chilton, ed.). Urban Environment, A. A. Balkema, Brookfield, VT, USA and Rotterdam, The Netherlands. pp. 399–404.
- Ellis, J. B. 2001 Sewer infiltration/exfiltration and interactions with sewer flows and groundwater quality. In: *INTERURBA II*, 19–22 February 2001, Lisbon, Portugal.
- Gu, B., Ying, G., Chang, S. X., Luo, W. D. & Chang, J. 2013 *Nitrate in groundwater of China: sources and driving forces*. *Global Environmental Change* **23**, 1112–1121.
- Gan, Y. P. 2017 Personal Communications on In- and Exfiltration of Sewer Systems in China.
- Han, D. M., Currel, M. J. & Cao, G. L. 2016 *Deep challenges of China's war on water pollution*. *Environmental Pollution* **218**, 1222–1235.
- Henze, M. 1992 Characterization of wastewater for modelling of activated sludge processes. *Water Science & Technology* **25** (6), 1–15.
- Henze, H. & Comeau, Y. 2008 Wastewater Characterization. In: *Biological Wastewater Treatment: Principles, Modelling and Design* (F. Henze, M. C. M. van Loosdrecht & G. A. Ekama, eds). IWA Publishing, London, UK, pp. 33–52.
- Henze, M., Harremoës, P., la Cour Jansen, J. & Arvin, E. 2002 *Wastewater Treatment: Biological and Chemical Processes*, 3rd edn. Springer-Verlag, Berlin, Germany.
- Huisman, J. L., Gasser, T., Gienal, C., Kühni, M., Krebs, P. & Gujer, W. 2004 *Quantification of oxygen fluxes in a long gravity sewer*. *Water Research* **38** (5), 1237–1247.
- Ji, F. Y. 2017 The influences of fine sand to resource recovery of sludge and technology for sand removal. In: *Annual Meeting of the Journal of Water and Wastewater*, Xiamen, China, 21 Oct 2017.
- Kroiss, H. 2015 *Energy Efficiency in Waste Water Treatment: Assessment Methodology and Practical Consequences*. NUS, Singapore, March 26, 2012.
- Li, J. 2018 Personal Communication on Mixed Liquor in Activated Sludge Tanks.
- Metcalf and Eddy 2003 *Wastewater Engineering Treatment and Reuse*, 4th edn. McGraw-Hill, New York, NY, USA.
- MHUR 2016 *Technology Guidelines to Solve Black and Odorous Urban River Water*.
- MHUR 2017 *Information System of China Municipal Wastewater Treatment*.
- Nielsen, P. H., Raunkjær, K., Norsker, N. H., Jensen, N. A. & Hvitved-Jacobsen, T. 1992 *Transformation of wastewater in sewer systems – a review*. *Water Science & Technology* **25** (6), 17–31.
- Puig, S., van Loosdrecht, M. C. M., Flameling, A. G., Colprim, J. & Meijer, S. C. F. 2010 *The effect of primary sedimentation on full-scale WWTP nutrient removal performance*. *Water Research* **44**, 3375–3384.
- Sollfrank, U. & Gujer, W. 1991 *Characterization of domestic wastewater for mathematical modelling of the activated sludge process*. *Water Science & Technology* **23** (4–6), 1057–1066.
- Tang, J. G. 2017 *River Water Quality: First Solve Sewer Filtration*. Urban Water. 13–20 June 2017.
- Wu, Y. Y. 2018 Personal Communication on Characteristics of Raw Sewage for Modeling.
- Yang, X. P. 2017 Personal Communications on In- and Exfiltration of Sewer Systems in China.
- Yang, A. M. 2018 Personal Communications on Characteristics of Raw Sewage for Modeling.
- Zhang, Y. 2017 *Urban Black and Odorous Water Bodies: Actions with Clear Goals*.
- Zheng, X. Z. 2017 Technology analysis and influencing factors analysis of municipal sludge volume reduction. In: *The 8th National Workshop of Municipal Sludge Treatment and Disposal*, 25 May 2017, Beijing, China.
- Zhou, Z., Wu, Z. C., Wang, Z. W., Tang, S. J. & Gu, G. W. 2008 *COD fractionation and parameter estimation for combined sewers by respirometric tests*. *Chemical Technology and Biotechnology* **83**, 1596–1601.

First received 17 October 2018; accepted in revised form 22 January 2019. Available online 31 January 2019